



What is a Consumer Confidence Report (CCR)?

- Annual Water Quality Report
- Communication between water system and consumer
- Stage to showcase your hard work

TAKE PRIDE IN YOUR REPORT

ENSURING CONSUMER CONFIDENCE



- Water systems provide an essential element for households
- CCRs assist consumers with choices that effect health
- Encourage consumers to appreciate and protect their water

8 MANDATORY ITEMS OF THE CCR

Item	Content Requirement
1	Water System Information
2	Source(s) of Water
3	Definitions
4	Detected Contaminant Table/Water Quality Table
5	Information on <i>Cryptosporidium</i> , Radon, and Other Contaminants
6	Required Health Effects Language
7	Violations / Variances and/or Exemptions
8	Required Additional Information

https://ofmpub.epa.gov/apex/safewater/f?p=ccr_iwriter

The screenshot shows the EPA website header with the logo and navigation links. Below the header, there's a search bar and a sidebar with links like 'CCR Home', 'Compliance Help', and 'FAQ from Consumers'. The main content area is titled 'Consumer Confidence Reports (CCR)' and 'Welcome to the CCR iWriter'. It includes a login form with fields for 'Username' and 'Password', a 'Login' button, and a link to 'Sign up' to create a user name or password. A 'WARNING NOTICE!' is displayed below the login form, stating that this is an EPA computer system for official business use only.

EPA United States Environmental Protection Agency

Learn the Issues Science & Technology Laws & Regulations About EPA Search EPA.gov

Consumer Confidence Reports (CCR)

Contact Us Share

Welcome to the CCR iWriter

This application enables you to produce a regulation compliant Consumer Confidence Report (CCR).

Login

Username

Password

Login

Don't remember your user name or password? Click [here](#).

[Sign up](#) to create a user name or password.

WARNING NOTICE!

This is a United States Environmental Protection Agency (EPA) computer system, which may be accessed and used only for official Government business. Unauthorized access or use of this computer system may subject violators to criminal, civil, and/or administrative action. All information on this computer system may be monitored, recorded, read, copied, and disclosed by and to authorized personnel for official purposes, including law enforcement. Access or use of this computer system by any person, whether authorized or unauthorized, constitutes consent to these terms.

The screenshot shows the 'CCR iWriter' report creation interface. It has a header with the EPA logo and 'CCR iWriter' title, and a 'Logout' link. Below the header, there's a navigation bar with 'Consumer Confidence Reports', 'My Account', 'Help', and 'Contact Us'. The main content area is titled 'Current Report: Town of Many' and includes a 'Return to Existing Reports' link. On the left, there's a sidebar with a list of report sections: '1. System Information', '2. Multiple Water Sources', '3. Consecutive System', '4. Contaminant Information Summary', '5. UCMR Contaminants Information', '6. Additional Contaminant Information', '7. Significant Deficiencies', '8. Cryptosporidium Monitoring', '9. Radon Monitoring', '10. Voluntary Monitoring', '11. Compliance with Other Rules', '12. Variance and Exemptions', and '13. Additional Languages'. The main content area is titled '1. System Information' and includes a '(*) indicates a required field' note. It contains several form fields: 'Report Title' (filled with 'Town of Many WY5600000'), 'Water System Name', 'Contact Name', 'Address', 'City', 'State', 'Zip Code', 'Phone', 'Fax', 'Email', 'CCR report URL', and 'Water System Homepage URL'. On the right, there's a 'System Type and Size' section with checkboxes for 'Ground Water', 'Ground Water Under Direct Influence of Surface Water', 'Surface Water', and 'Another Water System', and radio buttons for 'How many people does the system serve?' (Less than 10,000, 10,000 - 99,999, 100,000 or more). Navigation buttons '< Back' and 'Next >' are at the bottom.

EPA CCR iWriter Logout

Consumer Confidence Reports My Account Help Contact Us

Current Report: Town of Many Return to Existing Reports

CCR iWriter Report

- 1. System Information
- 2. Multiple Water Sources
- 3. Consecutive System
- 4. Contaminant Information Summary
- 5. UCMR Contaminants Information
- 6. Additional Contaminant Information
- 7. Significant Deficiencies
- 8. Cryptosporidium Monitoring
- 9. Radon Monitoring
- 10. Voluntary Monitoring
- 11. Compliance with Other Rules
- 12. Variance and Exemptions
- 13. Additional Languages

1. System Information

(*) indicates a required field.

* Report Title:

* Water System Name:

* Contact Name:

Address:

City:

State:

Zip Code:

* Phone:

Fax:

* Email:

CCR report URL:

Water System Homepage URL:

System Type and Size

Check each type that contributes water to the distribution system.

☐ Ground Water

☐ Ground Water Under Direct Influence of Surface Water

☐ Surface Water

☐ Another Water System


How many people does the system serve?

☐ Less than 10,000

☐ 10,000 - 99,999

☐ 100,000 or more

< Back Next >

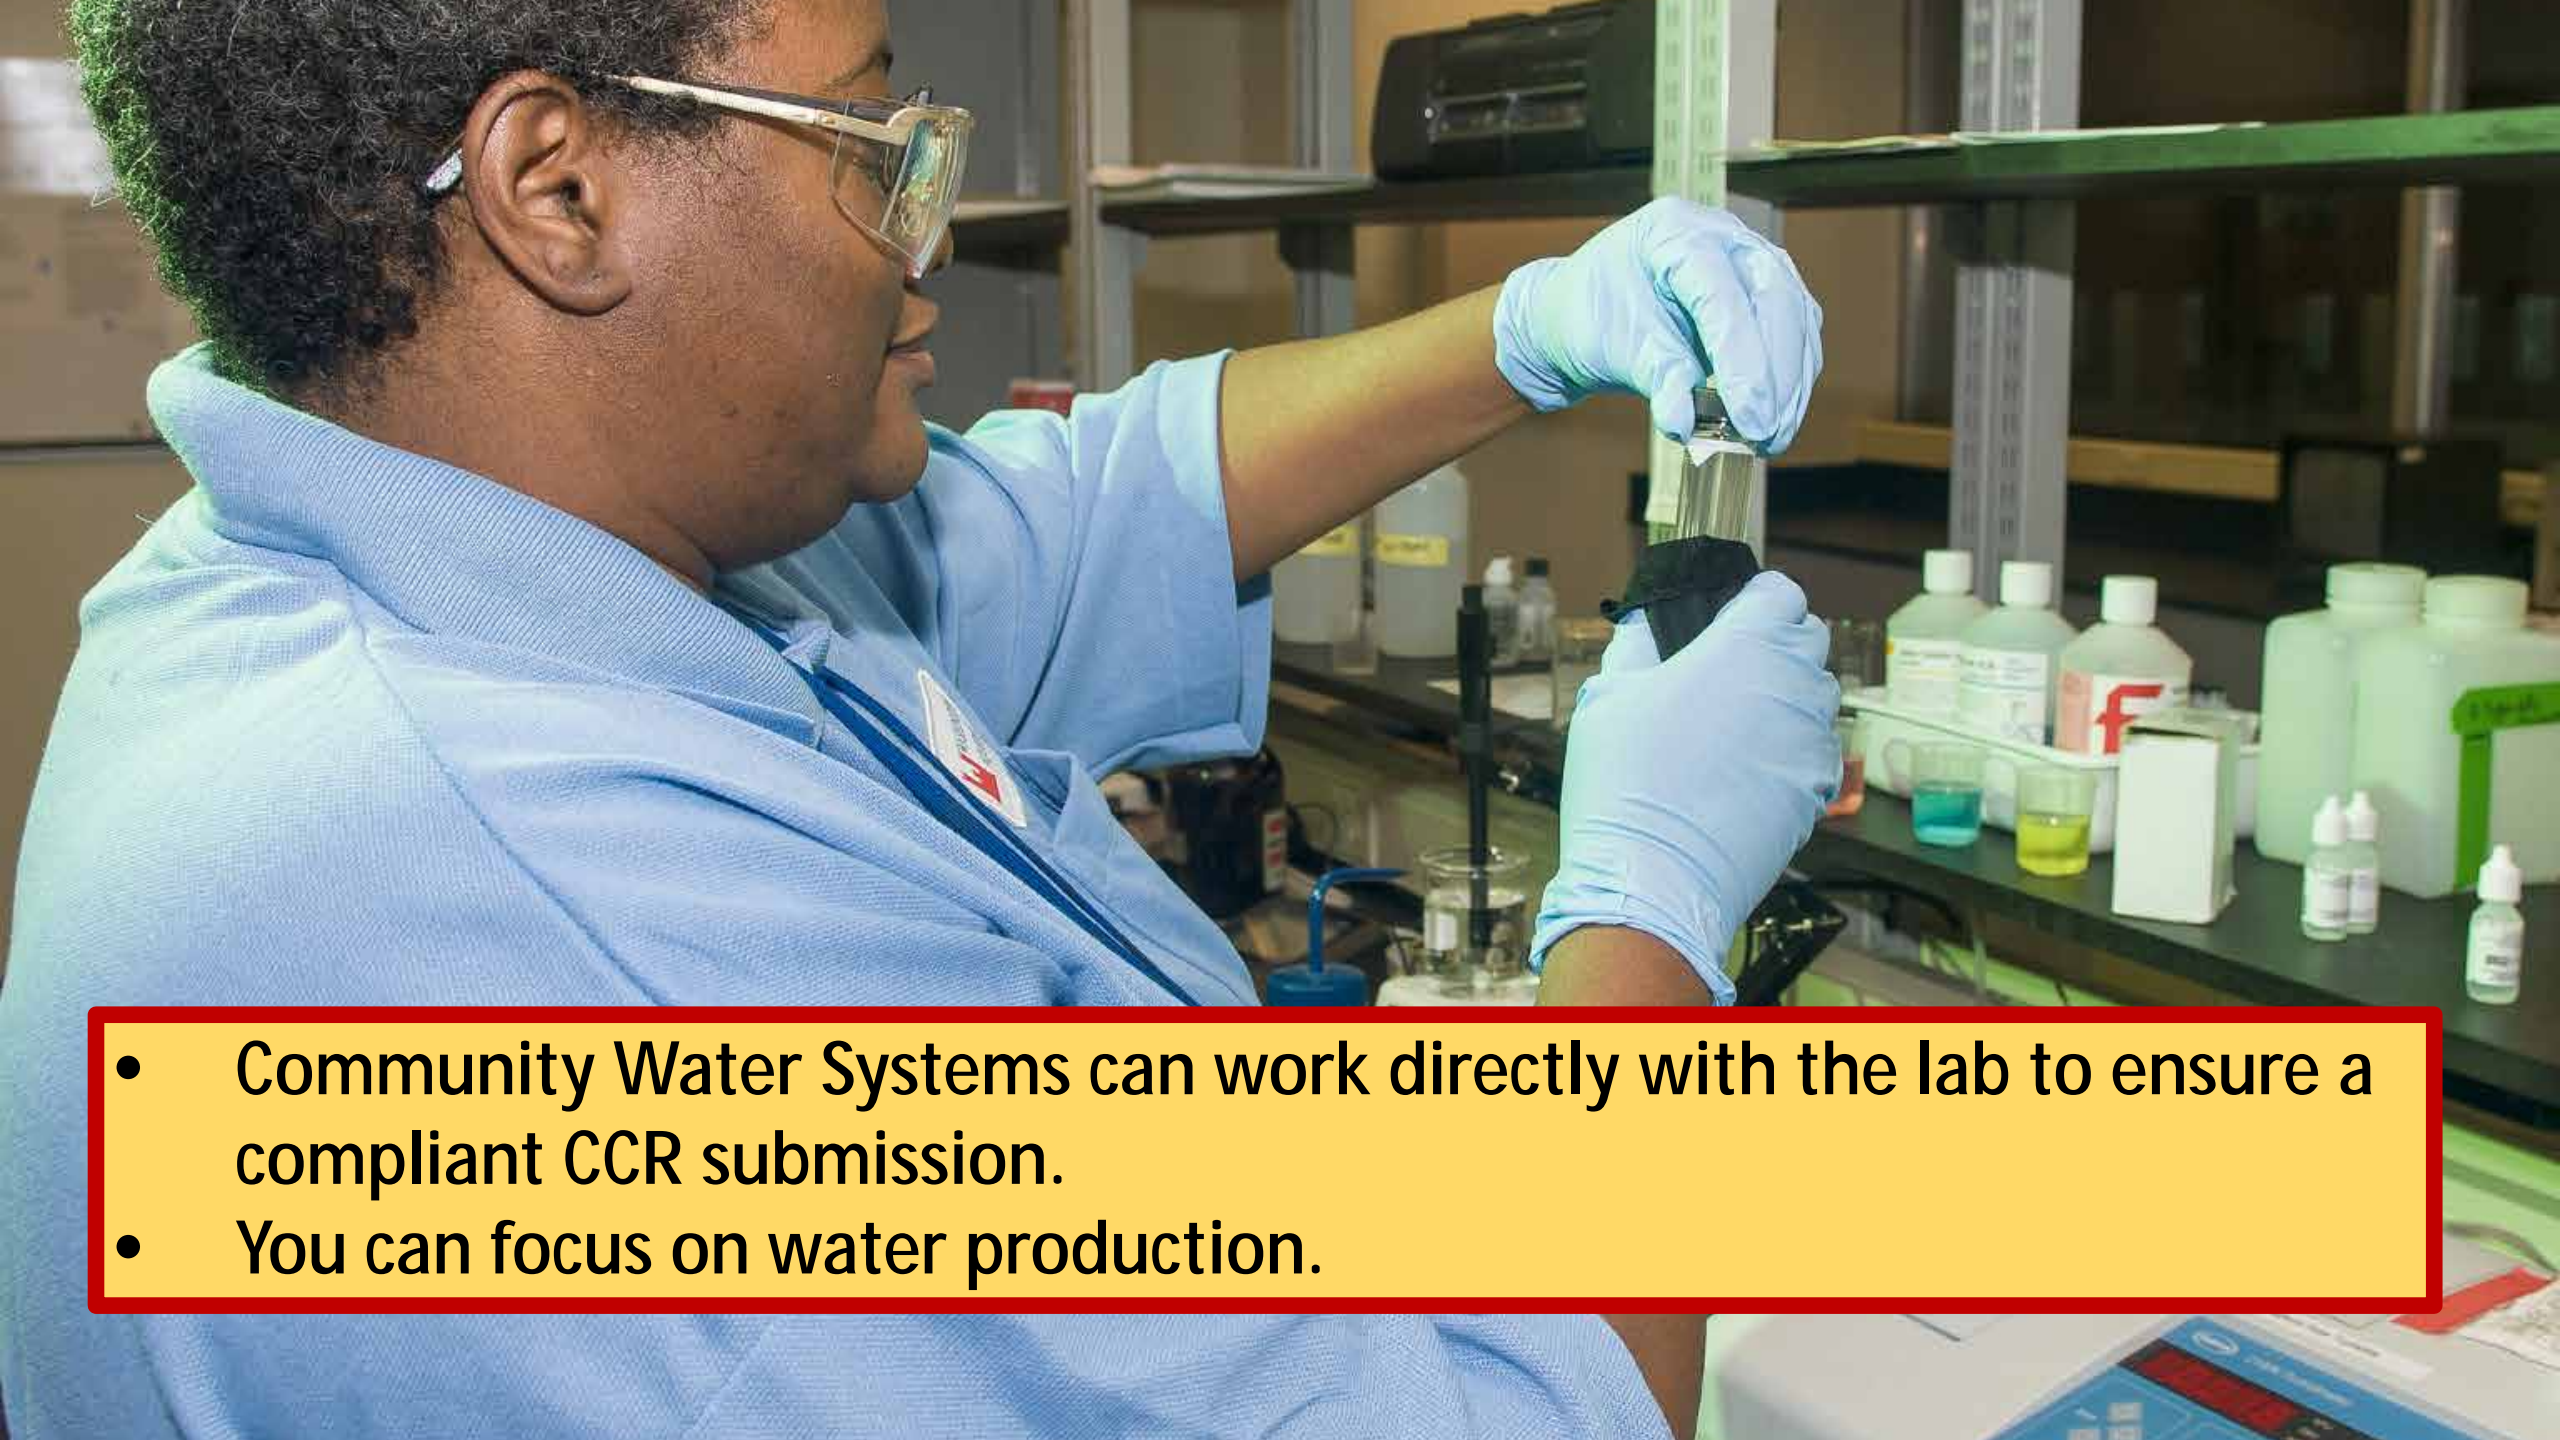


- Community Water Systems can work directly with the lab to ensure a compliant CCR submission.
- You can focus on water production.



NARA JIRIK
303-312-6789
jirik.nara@epa.gov

A time and resources allow, we review your CCR prior to submission and distribution to consumers to ensure compliance.


Region 8 Public Drinking Water Watch



Version 3.01

[Drinking Water Online Home](#)

Drinking Water Branch

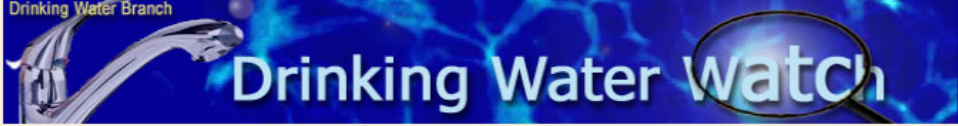

Drinking Water Watch

Region 8 Public DWW

-- Make A Selection --

Wyoming


Region 8 Tribes

Submit

[EPA Home](#) | [Privacy and Security Notice](#) | [Contact Us](#)

<https://sdwizr8.epa.gov/Region8DWWWPUB/>

Click on “Review Consumer Confidence Data”




Version 3.01

[Drinking Water Online Home](#)

[County Map](#)

[Glossary](#)



Drinking Water Watch

Public Water Supply Systems Search Parameters

Water System No.

Water System Name



Principal County Served

Water System Type

Primary Source Water Type

Sample Search Parameters

Sample Class

Sample Collection Date Range
(The Sample Search always produces results for the last 2 years, unless you provide a specific date range.)
  To 

[EPA Home](#) | [Privacy and Security Notice](#) | [Contact Us](#)

Enter or Select Water System; click “Generate Report”

Return Links
[Water System Search](#)
[County Map](#)

Glossary
[Glossary](#)

Drinking Water Branch

Review Consumer Confidence Data

Enter or Select Water System Or

Select CCR Year

Select Report Format

The report you are about to generate is designed to present the data you will need to assist with creating a regulation-compliant Consumer Confidence Report (CCR). It does not, in and of itself, satisfy the complete requirements of the Consumer Confidence Rule. You may wish to use EPA's CCR iWriter tool to produce a regulation-compliant Consumer Confidence Report. <http://www.ccrwriter.com>

[EPA Home](#) | [Privacy and Security Notice](#) | [Contact Us](#)

ITEM 1: WATER SYSTEM INFORMATION



Name and telephone number of a contact person

Information on public participation opportunities

Information for non-English speaking populations, if appropriate

Rule of Thumb: If you serve >5-10% non-English speaking people, include additional language(s) or access to information for translation.

Don't forget to put your water system name and PWS ID no. (WY56xxxxx) on your report!

ITEM 2: SOURCE(S) OF WATER

Type of water

Commonly-used name(s)

General location of water source(s)

Source water assessment information, if available:

Notice of availability of completed assessment

Information on how customers can obtain it

A brief summary of the system's susceptibility to potential sources of contamination

ITEM 4: DETECTED CONTAMINANTS

Essential part of the CCR!
Main table presents level of each detected contaminant

Detected contaminant is any regulated or unregulated contaminant detected at or above method detection limit (or reportable limit)

Most current detection levels are reported, up to five years

The EPA allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not vary significantly from year to year, or our system is not considered vulnerable to this type of contamination. Some of our data, though representative, are more than one year old.

Contaminants	MCLG or MRDLG	MCL, TT, or MRDL	Detect In Your Water	Range		Sample Date	Violation	Typical Source
				Low	High			
Disinfectants & Disinfection By-Products								
(There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants)								
Chlorine (as Cl2) (ppm)	4	4	1	1	1	2016	No	Water additive used to control microbes
Haloacetic Acids (HAA5) (ppb)	NA	60	10	NA	1.61	2016	No	By-product of drinking water chlorination
TTHMs [Total Trihalomethanes] (ppb)	NA	80	10	NA	NA	2016	No	By-product of drinking water disinfection
Inorganic Contaminants								
Barium (ppm)	2	2	.2	.1	.2	2015	No	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits
Fluoride (ppm)	4	4	.3	.7	1.1	2015	No	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories
Nitrate [measured as Nitrogen] (ppm)	10	10	6.9	5.5	6.9	2016	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
Sodium (optional) (ppm)	NA		28	120	140	2015	No	Erosion of natural deposits; Leaching
Microbiological Contaminants								
Turbidity (NTU)	NA	0.3	100	NA	NA	2016	No	Soil runoff
an once per year ary significantly from his type of re more than one year			ue of .3. A value less than 95% constitutes a TT violation. The highest ment in excess of 1 is a violation unless otherwise approved by the state.					
			5.7	3.3	5.7	2016	No	Erosion of natural deposits
			1	.3	1.8	2015	No	Erosion of natural deposits
			3	2	3	2016	No	Erosion of natural deposits

DEADLINES

JULY 2017						
SUN	MON	TUE	WED	THU	FRI	SAT
						 1
2	3	4	5	6	7	8
9	10	11	12	13	14	15
16	17	18	19	20	21	22
23	24	25	26	27	28	29
30	31					

Mail or directly deliver one copy
of CCR to customers and EPA
Region 8 **by July 1st**

2017 OCTOBER						
SUN	MON	TUE	WED	THU	FRI	SAT
 1	2	3	4	5	6	7
8	9	10	11	12	13	14
15	16	17	18	19	20	21
22	23	24	25	26	27	28
29	30	31				

Mail certification of compliance
to EPA Region 8 **by October 1st**

Wholesalers (selling water systems) must deliver data to consecutive systems (purchasing systems) by April 1st

DELIVERY REQUIREMENTS

- Mail, or otherwise directly deliver (e.g., hand deliver or electronic delivery), one CCR to each customer by July 1st every year
- In addition, make a “good faith” effort to reach non-bill paying consumers
- Make the CCR available upon request

Mailing Waiver for Small Systems

Serve <10,000 persons

1. Provide direct notice (paper, email) that CCR will be printed in a local newspaper or made available on an internet website, and
2. Publish CCR in local newspaper or on internet website, and
3. Make paper copies of the report available upon request.

Serve = or < 500 persons

1. Provide direct notice (paper, email) that report is available, and
2. Make paper copies of the report available upon request, or on an internet website.

A bison is standing in a dry, open landscape under a clear blue sky. In the background, there are rolling hills and several power line towers. The text "QUESTIONS?" is overlaid in the center of the image.

QUESTIONS?

TAKE PRIDE IN YOUR REPORT