

ESI

EnviroSystems, Inc.
P.O. Box 778
Hampton, NH 03843-0778
603-926-3345

August 6, 2009

Mr. Dave Walsh
Woods Hole Group, Inc.
81 Technology Park Drive
Falmouth, Massachusetts 02536

Dear Mr. Walsh;

Enclosed please find an electronic copy of our report evaluating the toxicity of samples received as part of the New Bedford Harbor surface water quality monitoring program for the 2009 sampling period. This report evaluates results of one (1) sample collected on July 22, 2009 and diluted to four (4) target concentrations (50, 100, 150, and 200 NTUs). Acute and chronic toxicity was evaluated using the mysid shrimp, *Americamysis bahia*, the sea urchin, *Arbacia punctulata*, and red macro algae, *Champia parvula*.

Please do not hesitate to call me, Reneé McIsaac or Petra Karbe should you have any questions regarding the report.

Sincerely,

EnviroSystems, Incorporated



Kenneth A. Simon
President

Enclosure

Report; Two (2) Copies
Study Number 18770-09-07

**Biomonitoring of Surface Water Samples
New Bedford Harbor
New Bedford, Massachusetts**

July 22, 2009 Sampling Event

NED ACOE Job Number: TO-0010

Task Order No.: ESI0002

Prepared for

Woods Hole Group, Inc.
81 Technology Park Drive
Falmouth, Massachusetts 02536

Prepared by

EnviroSystems, Incorporated
1 Lafayette Road
Hampton, New Hampshire 03843

July 2009
Reference Number: Woods Hole Group, Inc. 18770-09-07

**Biomonitoring of Surface Water Samples
New Bedford Harbor, New Bedford, Massachusetts**

**July 22, 2009 Sampling Event
NED ACOE Job Number: TO-0010**

1.0 INTRODUCTION

This report provides a summarization of data generated from acute and chronic exposure screening assays evaluating surface water samples collected from New Bedford Harbor in New Bedford, Massachusetts. Toxicity tests were conducted on grab surface water samples collected from the specified areas in the harbor. Assay design included a laboratory control treatment and one or more surface water samples. Samples were evaluated "As Received" without additional dilutions. Assays were conducted based on water quality levels in the vicinity of dredging operations. Samples were collected under the supervision of Woods Hole Group, Inc. personnel from the Falmouth, Massachusetts office. Testing was based on programs and protocols developed by the US EPA (2002) and included the following assays; 48 hour acute assays conducted with the mysid shrimp, *Americanamysis bahia*, and the red macro alga, *Champia parvula*, and 60 minute chronic fertilization assays conducted with the purple sea urchin, *Arbacia punctulata*. All mysid and urchin fertilization assays and the acute survival portion of the algal assays were conducted by ESI at its Hampton, New Hampshire facility.

2.0 MATERIALS AND METHODS

2.1 General Methods

Toxicological and analytical protocols used in this program followed procedures primarily designed by the EPA to provide standard approaches for the evaluation of toxicological effects of discharges on aquatic organisms, and for the analysis of water samples.

2.2 Test Species

A. bahia were obtained from cultures maintained by Aquatic Research Organisms (ARO), Hampton, New Hampshire. Juvenile shrimp were collected daily, isolated, and placed in a rearing tank for up to 6 days. Holding tanks were maintained in a flow-through culture mode at a temperature of $25\pm2^{\circ}\text{C}$. At the start of the assays the mysids were 7 days old. Juveniles were fed ≤ 24 hour old brine shrimp on a daily basis. Water temperature, salinity, and pH were monitored on a daily basis. Prior to testing, organisms were siphoned from the rearing tanks to a holding vessel, and then transferred to test chambers using a large bore pipet, minimizing the amount of water added to test solutions.

A. punctulata adults were from cultures maintained by ESI. Original stock was obtained from commercial supply. Male and female urchins are maintained in separate chambers as recommended by protocol (EPA 2002) and ESI. Adult urchins were induced to spawn by the injection of a potassium chloride solution. The viability of gametes obtained was determined prior to their addition to the test solutions. Eggs and/or sperm that would not result in a fertilized egg were rejected from the pool of gametes used in the assay.

C. parvula were from cultures maintained by Saskatchewan Research Council. The male and female plants are maintained in separate culture vessels under sterile conditions. Algal cultures were maintained on an orbital shaker (100 rpm) at $23\pm2^{\circ}\text{C}$ under 16 hour light : 8 hours dark at 40 to 75 foot candles light intensity. Cultures are "cropped" and transferred to fresh nutrient solutions on a weekly basis.

2.3 Surface Water Samples and Laboratory Control Water

A grab surface water sample was collected in New Bedford Harbor and diluted, in the field, to nominal 50, 100, 150, and 200 NTUs by Woods Hole Group, Inc. staff on July 22, 2009. Actual turbidity levels were documented by Alpha Analytical Labs after the start of the assays. Sample receipt information is shown in Table 1. Samples were placed in polyethylene cubitainers for shipment to the laboratory. One 5.0 gallon cubitainer was collected for each of the chronic assays. Prior to testing, samples were evaluated to document

salinity, conductivity, and total residual chlorine. Total residual chlorine was measured by amperometric titration (MDL 0.02 mg/L). Prior to use in the assays, the salinity of the samples was adjusted, as necessary, to predetermined levels using artificial sea salts for *A. bahia* and *A. punctulata* assays, and GP-2 salts (EPA 2002) for the *C. parvula* assays. When necessary, the salinity of samples for the *A. bahia* acute and chronic exposure assays were adjusted to $25\pm2\%$ while samples used for the *A. punctulata* and *C. parvula* assays were adjusted to $30\pm2\%$. Samples with "as received" salinity above these levels were not adjusted. A summary of "As Received" water quality data are summarized in Table 2.

Laboratory control water used for the mysid and sea urchin assays was collected from the Hampton/Seabrook Estuary. This water is classified as SA-1 and has been used to culture marine test organisms since 1981. The laboratory control water used in the algal assay (48 hour acute portion), collected from Hampton Harbor, New Hampshire, is the same water used in culture maintenance. Prior to use, seawater used in the algal assays was filtered through glass fiber filters and sterilized. Control water used in the algal assays conducted by AquaTox (acute and chronic portions) was natural seawater collected from the West Coast of Canada. Salinity of the surface water samples was adjusted, as required, using commercial sea salts.

2.4 Bioassays

2.4.1 *Americamysis bahia* Acute Exposure Assays

The endpoint for the *A. bahia* bioassay was survival (acute). The 48 hour static acute toxicity tests were conducted at $25\pm1^{\circ}\text{C}$ with a photoperiod of 16:8 hours light:dark. Test chambers for the acute assays were 250 mL glass beakers containing 200 mL test solution in each of 4 replicates with 10 organisms/replicate. Survival and dissolved oxygen were measured daily in each replicate prior to test solution renewal. Salinity, temperature and pH were recorded in a composite sample of the "old" test solution and in the "new" test solution prior to being added to the test chamber. Specific conductivity was measured in one replicate of each sample at the start of the assay. Mysids were not fed during the assay.

2.4.2 *Arbacia punctulata* Chronic Exposure Fertilization Assays

The endpoint for the *A. punctulata* bioassay was fertilization. Gametes were obtained by potassium chloride injection to induce spawning. Sperm were collected dry, diluted to achieve a concentration of approximately 5.0×10^7 sperm/mL in the surface water treatments. Actual sperm concentrations are provided on laboratory bench sheets in Appendix A. Sperm solutions were added to 5 mL aliquots of each sample being evaluated and allowed to remain in the test solutions for 60 minutes before the addition of unfertilized eggs. Each treatment incorporated a total of four (4) replicates. After 20 minutes exposure, the assay was terminated by the addition of 0.2 mL of preservative. Aliquots of preserved solution were counted to determine numbers of fertilized and unfertilized eggs. Fertilization was accepted based on the presence or absence of a fertilization membrane around the egg.

2.4.3 *Champia parvula* Acute Exposure Assays

The target endpoints for the acute *C. parvula* bioassay were coloration and necrosis. The red algae assay was conducted with a 2 day exposure period to the surface waters and laboratory control treatments. Each treatment used four replicates with five female branches and one male branch per replicate. Temperature was maintained at $23\pm1^{\circ}\text{C}$. The light source was cool white and fluorescent bulbs set on a 16:8 hours light:dark cycle, with a light intensity of 40 to 75 foot candles. Light intensity was checked at the start of each assay. Temperatures were monitored on a daily basis. Test chambers were 200 mL borosilicate glass fleakers. Upon test termination, plants were examined to determine the physical condition and coloration of the individual branches. Branches showing signs of degeneration were noted and used to establish an acute endpoint. Data for the acute endpoints was generated by ESI.

2.5 Data Analysis

Statistical analysis of acute and chronic exposure data was completed using CETIS, Comprehensive Environmental Toxicity Testing System, software. The program computes acute and chronic exposure endpoints based on EPA decision tree guidelines specified in individual test methods. For chronic exposure

endpoints statistical significance was accepted at $\alpha < 0.05$.

2.6 Quality Control

As part of the laboratory quality control program, standard reference toxicant assays are conducted on a regular basis for each test species. These results, summarized in Table 4, provide relative health and response data while allowing for comparison with historic data sets.

2.7 Protocol Deviations and Unacceptable Assays

Review of data collected from the assays conducted during the monitoring period documented one protocol deviations. Typically, the 48 hour acute exposure assay with the mysid shrimp is completed using <5 day old test organisms, however 7 day old organisms were acquired in anticipation of running the modified 7-day chronic assay which includes a 48-hour acute exposure endpoint. It is the opinion of ESI's study director that this deviation had no impact on the outcome of the assay.

3.0 RESULTS SUMMARY

Table 3 provides summaries of survival, growth, development and reproduction endpoints and associated statistical analyses. Support data, including copies of laboratory bench sheets, are provided in Appendix A.

For this round of sample analysis there were one reference site sample (DS-TOX-005-072209). The laboratory control and reference site were both used for statistical comparisons against the four samples provided by Woods Hole Group (DS-TOX-001-072209 through DS-TOX-004-072209).

3.1 *Americanasys bahia* Acute Exposure Bioassay

Minimum test acceptability criteria for the acute exposure bioassay require $\geq 90\%$ survival in the control concentrations. Achievement of these results indicate that healthy test organisms were used. See Table 3 for test acceptability and data summary.

3.2 *Arbacia punctulata* Chronic Fertilization Bioassay

Protocol specifies a 70% to 90% fertilization rate for *Arbacia punctulata* (EPA 2002). Achievement of these results indicate that healthy test organisms were used. See Table 3 for test acceptability and data summary.

3.3 *Champhia parvula* Acute Exposure Bioassay

The acute exposure bioassay was considered to be acceptable if no notable branch necrosis was observed and appropriate coloration of test species was achieved in the laboratory control treatment. Achievement of these results indicate that healthy test organisms were used. See Table 3 for test acceptability and data summary.

4.0 REFERENCES

- APHA. 1998. *Standard Methods for the Examination of Water and Wastewater*, 20th edition. Washington D.C.
- US EPA. 2002. *Methods for Measuring the Acute Toxicity of Effluents to Freshwater and Marine Organisms*. Fourth Edition. EPA-821-R-02-012.
- US EPA. 2002. *Short Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms*. Fourth Edition. EPA-821-R-02-013.

Table 1. Sample Receipt Summary. New Bedford Harbor Surface Water Quality Monitoring July 22, 2009 Sampling Event. New Bedford Harbor Dredge Plume Monitoring Program.

Field ID	ESI Code	Matrix	Collection		Receipt	
			Date	Time	Date	Time
DS-TOX-001-072209	18770-001	Water	07/22/09	0826	07/22/09	1747
DS-TOX-002-072209	18770-002	Water	07/22/09	0952	07/22/09	1747
DS-TOX-003-072209	18770-003	Water	07/22/09	0951	07/22/09	1747
DS-TOX-004-072209	18770-004	Water	07/22/09	0951	07/22/09	1747
DS-TOX-005-072209	18770-005	Water	07/22/09	0949	07/22/09	1747

Table 2 Summary of “As Received” Sample Physical and Chemical Characteristics. New Bedford Harbor Surface Water Quality Monitoring July 22, 2009 Sampling Event. New Bedford Harbor Dredge Plume Monitoring Program.

Field ID	ESI Code	Target Dilution (NTUs) / Reference	Measured Turbidity*	Ammonia (mg/L)	pH (SU)	Salinity (‰)	Total Residual Chlorine (mg/L)
DS-TOX-001-072209	18770-001	200	190	0.15	7.27	23	<0.02
DS-TOX-002-072209	18770-002	150	140	<0.1	7.37	19	<0.02
DS-TOX-003-072209	18770-003	100	110	<0.1	7.40	17	<0.02
DS-TOX-004-072209	18770-004	50	92	<0.1	7.54	22	<0.02
DS-TOX-005-072209	18770-005	Reference	7.2	<0.1	7.71	27	<0.02

COMMENTS:

* Turbidity was measured by Woods Hole Group and provided via email communication.

Table 3. Endpoint Summary Table - New Bedford Harbor Surface Water Quality Monitoring July 22, 2009 Sampling Event. New Bedford Harbor Dredge Plume Monitoring Program.

Sample ID	Turbidity	Reps (NTUs)	Mean	Min	Max	CV	Significant Difference vs	
			p Value	Lab	p Value	TOX-005		
<i>Arbacia punctulata</i>								
Lab Control	7.2	4	Portion Fertilized					
			98.8%	97.2%	100.0%	1.20%	-	-
			99.1%	98.1%	100.0%	1.09%	0.6185	NO
			93.7%	92.6%	96.2%	1.80%	0.0015	YES
			90.3%	88.0%	92.5%	2.04%	0.0002	YES
			98.1%	94.3%	100.0%	2.60%	0.3650	NO
DS-TOX-005	190	4	98.0%	97.0%	99.0%	0.84%	0.1386	NO
			Day 1 Survival					
			100.0%	100.0%	100.0%	0.00%	-	-
			100.0%	100.0%	100.0%	0.00%	0.4429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			100.0%	100.0%	100.0%	0.00%	0.4429	NO
DS-TOX-001	140	4	97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
DS-TOX-002	110	4	Day 2 Survival					
			100.0%	100.0%	100.0%	0.00%	-	-
			100.0%	100.0%	100.0%	0.00%	0.4429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			100.0%	100.0%	100.0%	0.00%	0.4429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
DS-TOX-003	92	4	97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
			97.5%	90.0%	100.0%	5.13%	0.3429	NO
<i>Chamisia parvula</i>								
Lab Control	7.2	4	Day 2 Coloration/Necrosis					
			4.0	4.0	4.0	0.00%	-	-
			3.2	3.0	3.4	5.10%	0.0143	YES
			0.0	0.0	0.0	0.00%	0.0143	YES
			0.8	0.6	1.0	20.41%	0.0143	YES
			2.0	1.8	2.0	5.13%	0.0143	YES
DS-TOX-005	190	4	2.9	2.8	3.0	3.98%	0.0000	YES
			Day 2 Coloration/Necrosis					
			4.0	4.0	4.0	0.00%	-	-
			3.2	3.0	3.4	5.10%	0.0143	YES
			0.0	0.0	0.0	0.00%	0.0143	YES
			0.8	0.6	1.0	20.41%	0.0143	YES
DS-TOX-001	140	4	2.0	1.8	2.0	5.13%	0.0143	YES
			2.9	2.8	3.0	3.98%	0.0000	YES
			Day 2 Coloration/Necrosis					
			4.0	4.0	4.0	0.00%	-	-
			3.2	3.0	3.4	5.10%	0.0143	YES
			0.0	0.0	0.0	0.00%	0.0143	YES
DS-TOX-002	110	4	2.0	1.8	2.0	5.13%	0.0143	YES
			2.9	2.8	3.0	3.98%	0.0000	YES
			Day 2 Coloration/Necrosis					
			4.0	4.0	4.0	0.00%	-	-
			3.2	3.0	3.4	5.10%	0.0143	YES
			0.0	0.0	0.0	0.00%	0.0143	YES
DS-TOX-003	92	4	2.0	1.8	2.0	5.13%	0.0143	YES
			2.9	2.8	3.0	3.98%	0.0000	YES
			Day 2 Coloration/Necrosis					
			4.0	4.0	4.0	0.00%	-	-
			3.2	3.0	3.4	5.10%	0.0143	YES
			0.0	0.0	0.0	0.00%	0.0143	YES

Table 4 Reference Toxicant Summary. New Bedford Harbor Surface Water Quality Monitoring July 22, 2009 Sampling Event. New Bedford Harbor Dredge Plume Monitoring Program.

Date	Endpoint		Value	Historic Mean/ Central Tendency	Acceptable Range	Reference Toxicant
<i>A. bahia</i>						
06/17/09	Survival	LC-50	23.8	20.8	16.2 - 25.4	SDS (mg/L)
05/27/09	Survival	C-NOEC	15.0	10.0	5.0 - 15.0	SDS (mg/L)
05/27/09	Growth	C-NOEC	5.0	5.0	2.5 - 10.0	SDS (mg/L)
.....						
<i>A. punctulata</i>						
06/18/09	Fertilization	C-NOEC	<1	10.0	1.0 - 5.0	Copper (μ g/L)
06/18/09	Fertilization	IC-25	1.0	19.9	0 - 66.1	Copper (μ g/L)
.....						
<i>C. parvula</i>						
06/08/09	Reproduction	IC-25	0.1	0.11	0.065 - 0.178	SDS (mg/L)
.....						

Mean and Acceptable Ranges based on most recent 20 reference toxicant assays (NELAP standard)

APPENDIX A

SUPPORT DATA

Contents	# Pages
Methods Summary	1
Study 18770: Sample Date July 22, 2009	
<i>A. bahia</i> Bench Sheets & Statistical Analysis Report	22
<i>A. punctulata</i> Bench Sheets and Statistical Analysis Report	12
<i>C. parvula</i> Bench Sheets and Statistical Analysis Report	12
Water Quality Bench Sheets and Dilution Prep Sheets	3
Analytical Chemistry Report	2
Sample Receipt Records	1
Chain of Custody and Organism Shipping Information	1
Total Appendix Pages	54

METHODS USED IN NPDES PERMIT BIOMONITORING TESTING

Parameter	Method
Acute Exposure Bioassays:	
<i>Ceriodaphnia dubia, Daphnia pulex</i>	EPA-821-R-02-012
<i>Pimephales promelas</i>	EPA-821-R-02-012
<i>Americamysis bahia</i>	EPA-821-R-02-012
<i>Menidia beryllina, Cyprinodon variegatus</i>	EPA-821-R-02-012
Chronic Exposure Bioassays:	
<i>Ceriodaphnia dubia</i>	EPA-821-R-02-013 1002.0
<i>Pimephales promelas</i>	EPA-821-R-02-013 1000.0
<i>Cyprinodon variegatus</i>	EPA-821-R-02-014 1004.0
<i>Menidia beryllina</i>	EPA-821-R-02-014 1006.0
<i>Arbacia punctulata</i>	EPA-821-R-02-014 1008.0
<i>Champia parvula</i>	EPA-821-R-02-014 1009.0
Trace Metals:	
Trace Metals	EPA 200.7/SW 6010 and EPA 200.8/SW 6020
Hardness	Standard Methods 20 th Edition - Method 2340 B
Wet Chemistries:	
Alkalinity	EPA 310.2
Chlorine, Residual	Standard Methods 20 th Edition - Method 4500CLD
Total Organic Carbon	Standard Methods 20 th Edition - Method 5310C
Specific Conductance	Standard Methods 20 th Edition - Method 2510B
Nitrogen - Ammonia	Standard Methods 20 th Edition - Method 4500NH3G
pH	Standard Methods 20 th Edition - Method 4500H+B
Solids, Total (TS)	Standard Methods 20 th Edition - Method 2540 B
Solids, Total Suspended (TSS)	Standard Methods 20 th Edition - Method 2540 D
Solids, Total Dissolved (TDS)	Standard Methods 20 th Edition - Method 2540 C
Dissolved Oxygen	Standard Methods 20 th Edition - Method 4500-O G

ACUTE BIOASSAY DATA SUMMARY

STUDY: 18770	"AS RECEIVED" EFFLUENT AND DILUENT CHEMISTRIES									
CLIENT: Woods Hole Group	TEST ORGANISM: <i>A. bahia</i>		TRC	TS/TSS	AMM	TOC	T.METAL	SAL	pH	S/C
SAMPLE: New Bedford Harbor	ORGANISM SUPPLIER/BATCH/AGE: <i>See Organism Culture Sheet</i>	EFF								
		DIL								

ACUTE BIOASSAY DATA SUMMARY

CETIS Summary Report

 Report Date: 27 Jul-09 10:52 (p 1 of 1)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.					
Sample Code	Sample No	Sample Date	Receive Date	Sample Age	Client Name	Project						
18770-000	06-7167-7012	23 Jul-09 12:00	23 Jul-09 12:00	4h	Woods Hole Group				Ecological Risk Assessme			
18770-005	03-9927-1818	22 Jul-09 09:49	22 Jul-09 17:47	30h								
18770-001	15-6024-8561	22 Jul-09 08:26	22 Jul-09 17:47	32h								
18770-002	05-1145-9131	22 Jul-09 09:52	22 Jul-09 17:47	30h								
18770-003	01-6638-4937	22 Jul-09 09:51	22 Jul-09 17:47	30h								
18770-004	06-1076-1745	22 Jul-09 09:51	22 Jul-09 17:47	30h								
Sample Code	Material Type	Sample Source			Station Location		Latitude	Longitude				
18770-000	Surface Water	New Bedford Harbor Dredge Moni Laboratory Water Control										
18770-005	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-005-072209 (Reference)										
18770-001	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-001-072209 (190 NTU)										
18770-002	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-002-072209 (140 NTU)										
18770-003	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-003-072209 (110 NTU)										
18770-004	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-004-072209 (092 NTU)										
24h Proportion Survived Summary												
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%		
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%		
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%		
18770-001	4	0.975	0.9563	0.9937	0.9	1	0.009129	0.05	5.13%	2.5%		
18770-002	4	1	1	1	1	1	0	0	0.0%	0.0%		
18770-003	4	0.975	0.9563	0.9937	0.9	1	0.009129	0.05	5.13%	2.5%		
18770-004	4	0.975	0.9563	0.9937	0.9	1	0.009129	0.05	5.13%	2.5%		
48h Proportion Survived Summary												
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%		
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%		
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%		
18770-001	4	0.975	0.9563	0.9937	0.9	1	0.009129	0.05	5.13%	2.5%		
18770-002	4	1	1	1	1	1	0	0	0.0%	0.0%		
18770-003	4	0.975	0.9563	0.9937	0.9	1	0.009129	0.05	5.13%	2.5%		
18770-004	4	0.975	0.9563	0.9937	0.9	1	0.009129	0.05	5.13%	2.5%		
24h Proportion Survived Detail												
Sample Code	Rep 1	Rep 2	Rep 3	Rep 4								
18770-000	1	1	1	1								
18770-005	1	1	1	1								
18770-001	1	1	1	0.9								
18770-002	1	1	1	1								
18770-003	1	0.9	1	1								
18770-004	1	1	1	0.9								
48h Proportion Survived Detail												
Sample Code	Rep 1	Rep 2	Rep 3	Rep 4								
18770-000	1	1	1	1								
18770-005	1	1	1	1								
18770-001	1	1	1	0.9								
18770-002	1	1	1	1								
18770-003	1	0.9	1	1								
18770-004	1	1	1	0.9								

CETIS Analytical Report

Report Date: 24 Jul-09 14:41 (p 1 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	17-8622-6234	Endpoint:	24h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	24 Jul-09 14:37	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:			
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable		
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts		
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-004	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-004	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-004	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										

CETIS Analytical Report

Report Date: 24 Jul-09 14:41 (p 2 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test		EnviroSystems, Inc.								
Analysis No:	02-9572-0498	Endpoint:	24h Proportion Survived							
Analyzed:	24 Jul-09 14:37	Analysis:	Nonparametric-Two Sample							
CETIS Version:	CETISv1.6.4	Official Results:	Yes							
Test Run No:	13-1803-3614	Test Type:	Survival (48h)							
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)							
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia							
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH							
Data Transform	Zeta	Alt Hyp	Monte Carlo							
Angular (Corrected)		C > T	Not Run							
			5.56%							
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-003	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test	Test Stat	Critical	P-Value	Decision(1%)					
Variances	Mod Levene Equality of Variances	1	13.75	0.3559	Equal Variances					
Distribution	Shapiro-Wilk Normality	0.7065		0.0027	Non-normal Distribution					
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-003	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-003	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										
24h Proportion Survived	Sample Code	Centered Corr. Angle	Ranks							

CETIS Analytical Report

Report Date: 24 Jul-09 14:41 (p 3 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.				
Analysis No:	12-4998-4748	Endpoint:	24h Proportion Survived				CETIS Version:	CETISv1.6.4			
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample				Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD			
Angular (Corrected)		C > T	Not Run					2.5%			
Wilcoxon Rank Sum Two-Sample Test											
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)				
18770-005		18770-002	18		1	0.4429	Non-Significant Effect				
ANOVA Table											
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)					
Between	0	0	1	65540	0.0000	Significant Effect					
Error	0	0	6								
Total	0	0	7								
ANOVA Assumptions											
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)					
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances					
24h Proportion Survived Summary											
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%	
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%	
18770-002	4	1	1	1	1	1	0	0	0.0%	0.0%	
Angular (Corrected) Transformed Summary											
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%	
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%	
18770-002	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%	
Graphics											

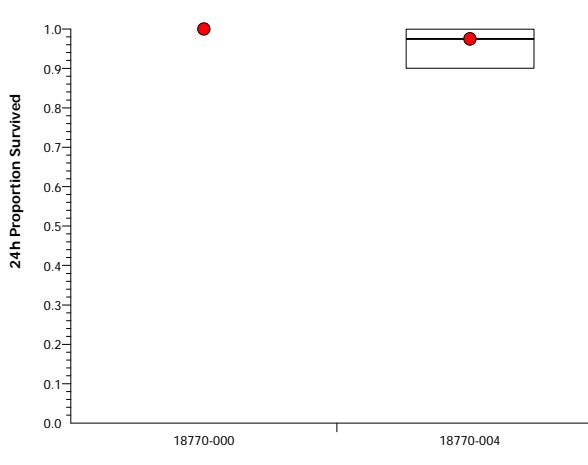
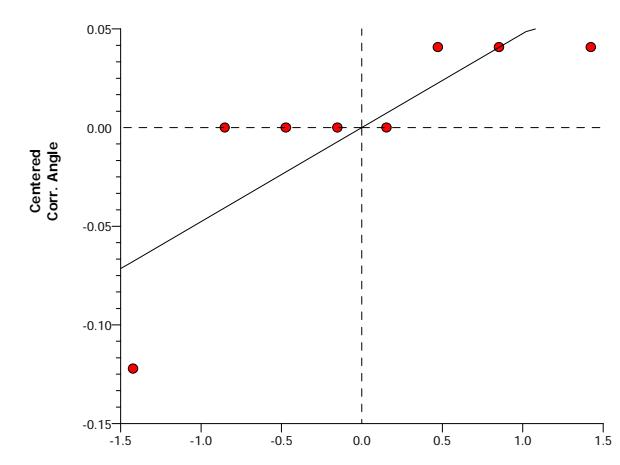
CETIS Analytical Report

Report Date: 24 Jul-09 14:41 (p 4 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	06-0548-8740	Endpoint:	24h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:			
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable		
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts		
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-001	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-001	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-001	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										

CETIS Analytical Report

Report Date: 24 Jul-09 14:41 (p 5 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test						EnviroSystems, Inc.				
Analysis No:	03-9607-9833	Endpoint:	24h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample			Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)			Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)			Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia			Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-004	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-004	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-004	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										
										

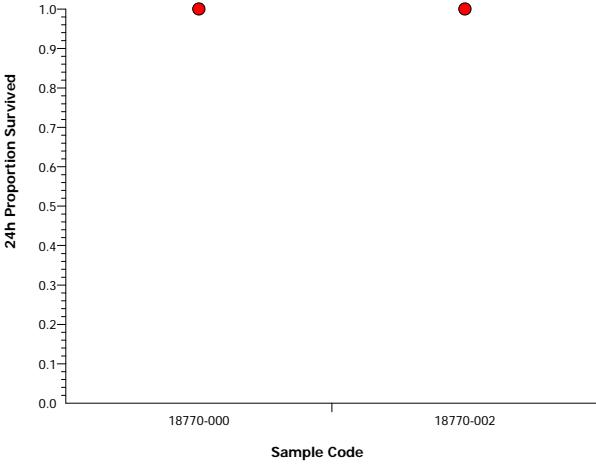
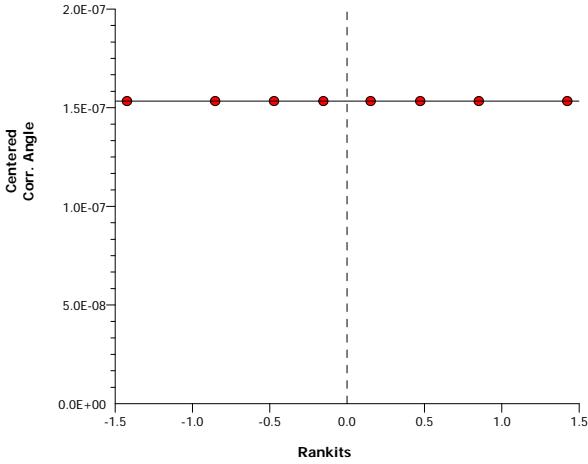
CETIS Analytical Report

Report Date: 24 Jul-09 14:41 (p 6 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test		EnviroSystems, Inc.								
Analysis No:	11-8632-2466	Endpoint:	24h Proportion Survived							
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample							
CETIS Version:	CETISv1.6.4	Official Results:	Yes							
Test Run No:	13-1803-3614	Test Type:	Survival (48h)							
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)							
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia							
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH							
Data Transform	Zeta	Alt Hyp	Monte Carlo							
Angular (Corrected)	C > T	Not Run	5.56%							
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-003	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test	Test Stat	Critical	P-Value	Decision(1%)					
Variances	Mod Levene Equality of Variances	1	13.75	0.3559	Equal Variances					
Distribution	Shapiro-Wilk Normality	0.7065		0.0027	Non-normal Distribution					
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-003	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-003	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										

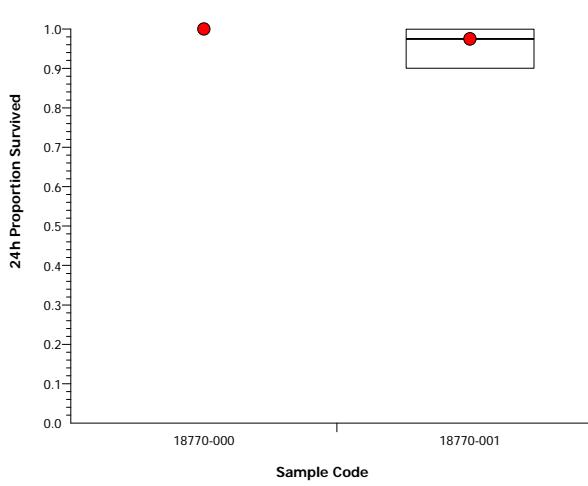
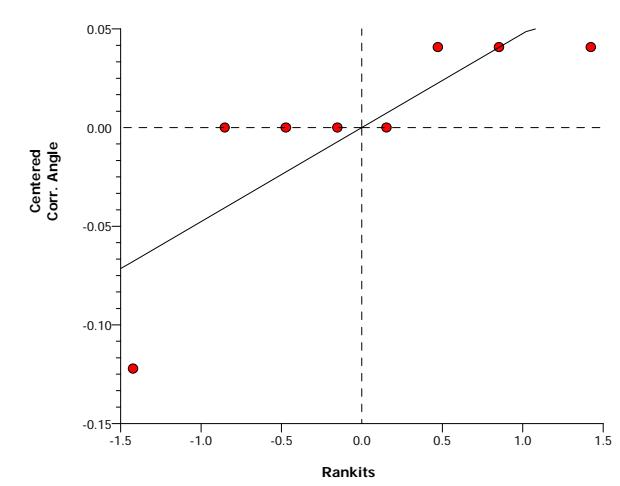
CETIS Analytical Report

Report Date: 24 Jul-09 14:42 (p 7 of 9)
Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test						EnviroSystems, Inc.				
Analysis No:	11-2256-6280	Endpoint:	24h Proportion Survived			CETIS Version:	CETISv1.6.4			
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample			Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)			Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)			Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia			Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					2.5%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-002	18		1	0.4429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0	0	1	65540	0.0000	Significant Effect				
Error	0	0	6							
Total	0	0	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances				
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-002	4	1	1	1	1	1	0	0	0.0%	0.0%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-002	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
Graphics										
										

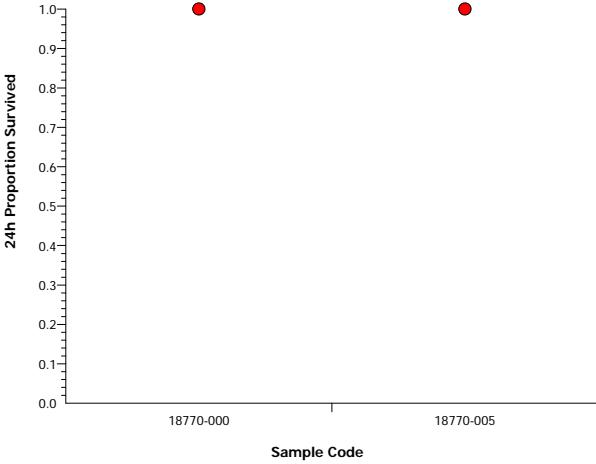
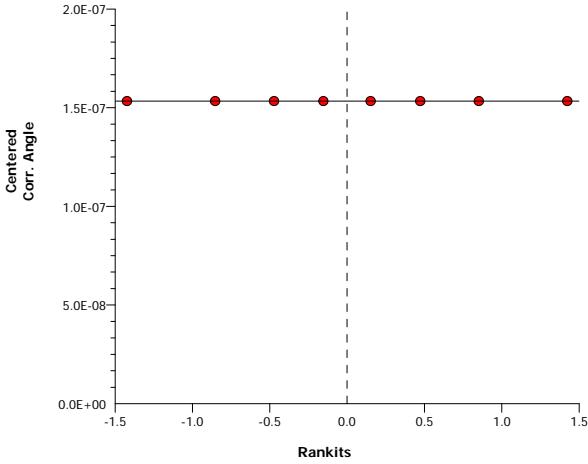
CETIS Analytical Report

Report Date: 24 Jul-09 14:42 (p 8 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	04-4072-4585	Endpoint:	24h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:			
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable		
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts		
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-001	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-001	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-001	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										
										

CETIS Analytical Report

Report Date: 24 Jul-09 14:42 (p 9 of 9)
Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test						EnviroSystems, Inc.				
Analysis No:	19-2609-4608	Endpoint:	24h Proportion Survived			CETIS Version:	CETISv1.6.4			
Analyzed:	24 Jul-09 14:36	Analysis:	Nonparametric-Two Sample			Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)			Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)			Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia			Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					2.5%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-005	18		1	0.4429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0	0	1	65540	0.0000	Significant Effect				
Error	0	0	6							
Total	0	0	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances				
24h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
Graphics										
										

CETIS Analytical Report

Report Date: 27 Jul-09 10:50 (p 1 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.				
Analysis No:	09-2386-3109	Endpoint:	48h Proportion Survived				CETIS Version:	CETISv1.6.4			
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample				Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD			
Angular (Corrected)		C > T	Not Run					5.56%			
Wilcoxon Rank Sum Two-Sample Test											
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)				
18770-005		18770-004	16		1	0.3429	Non-Significant Effect				
ANOVA Table											
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)					
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect					
Error	0.0199195	0.0033199	6								
Total	0.0232394	0.00666398	7								
ANOVA Assumptions											
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)					
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances					
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution					
48h Proportion Survived Summary											
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%	
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%	
18770-004	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%	
Angular (Corrected) Transformed Summary											
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%	
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%	
18770-004	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%	
Graphics											

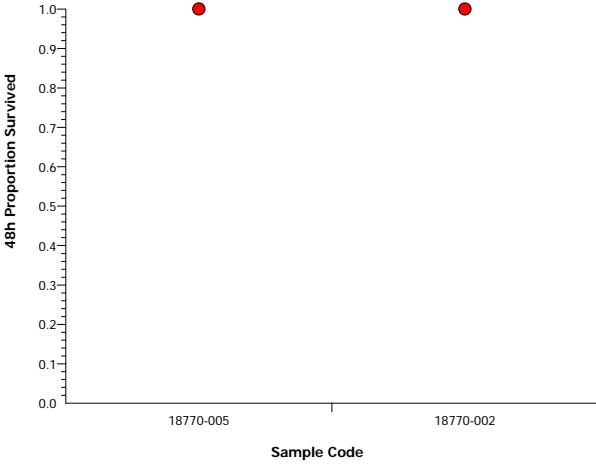
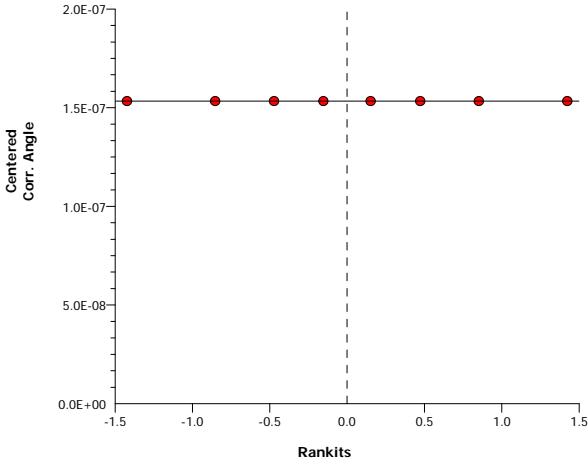
CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 2 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	20-9989-5516	Endpoint:	48h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:			
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable		
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts		
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-003	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-003	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-003	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										

CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 3 of 9)
Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test						EnviroSystems, Inc.				
Analysis No:	11-3419-3984	Endpoint:	48h Proportion Survived			CETIS Version:	CETISv1.6.4			
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample			Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)			Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)			Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia			Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					2.5%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-002	18		1	0.4429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0	0	1	65540	0.0000	Significant Effect				
Error	0	0	6							
Total	0	0	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances				
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-002	4	1	1	1	1	1	0	0	0.0%	0.0%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-002	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
Graphics										
										

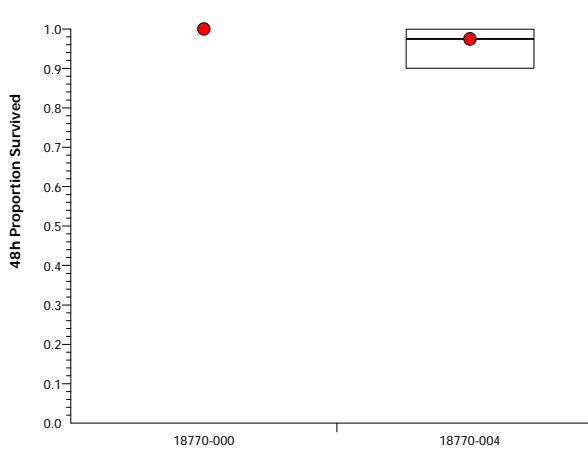
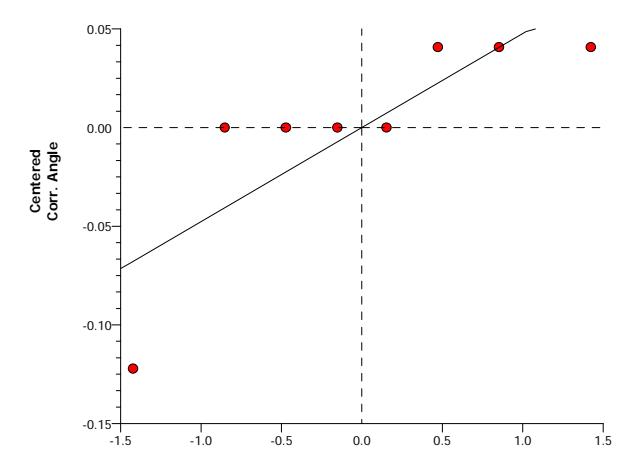
CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 4 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	04-5963-4047	Endpoint:	48h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:			
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable		
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts		
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-001	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-001	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-001	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										

CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 5 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

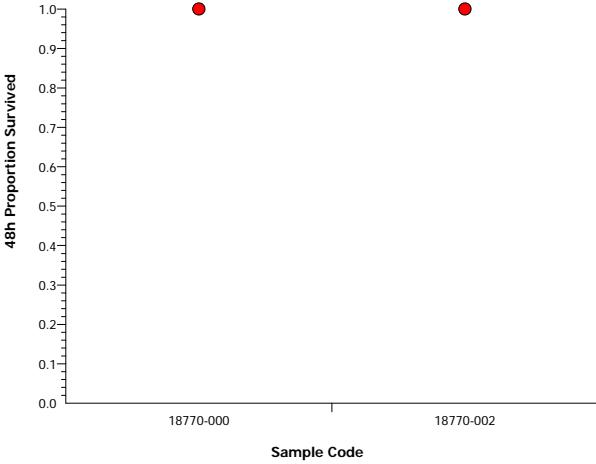
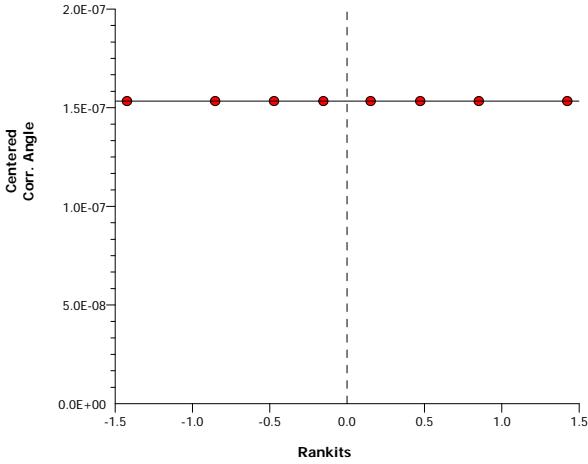
Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	17-1499-2035	Endpoint: 48h Proportion Survived			CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 10:48	Analysis: Nonparametric-Two Sample			Official Results:	Yes				
Test Run No:	13-1803-3614	Test Type: Survival (48h)			Analyst:					
Start Date:	23 Jul-09 16:00	Protocol: EPA/821/R-02-012 (2002)			Diluent:	Not Applicable				
Ending Date:	25 Jul-09 16:00	Species: Americamysis bahia			Brine:	Generic commercial salts				
Duration:	48h	Source: ARO - Aquatic Research Organisms, NH			Age:					
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-004	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc	1	13.75	0.3559	Equal Variances					
Distribution	Shapiro-Wilk Normality	0.7065		0.0027	Non-normal Distribution					
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-004	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-004	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										
										

CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 6 of 9)
Link/Link Code: 14-7067-7011/18770-Ab

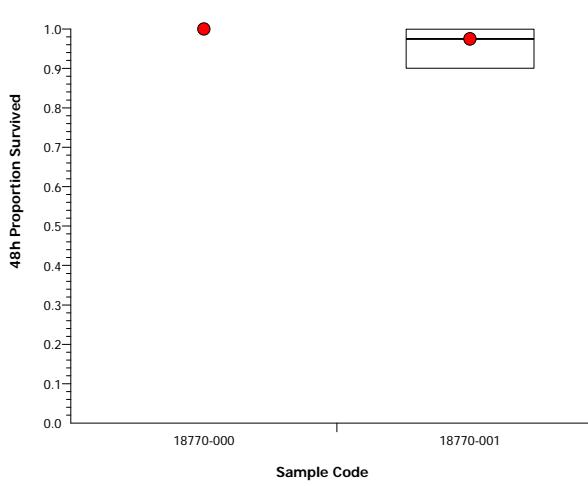
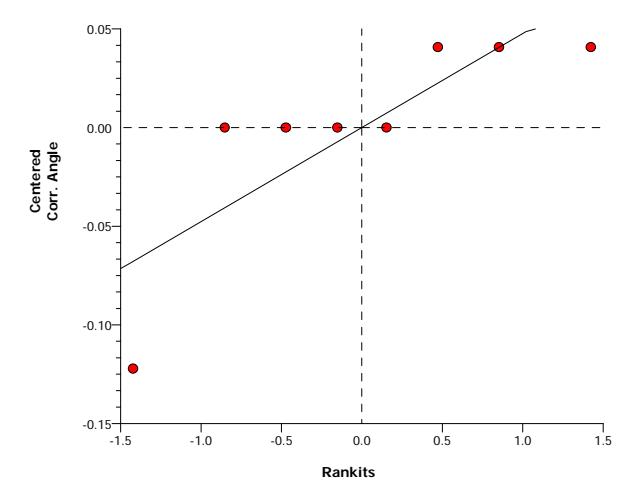
CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 7 of 9)
Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test						EnviroSystems, Inc.				
Analysis No:	14-6729-0743	Endpoint:	48h Proportion Survived			CETIS Version:	CETISv1.6.4			
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample			Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)			Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)			Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia			Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					2.5%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-002	18		1	0.4429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0	0	1	65540	0.0000	Significant Effect				
Error	0	0	6							
Total	0	0	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances				
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-002	4	1	1	1	1	1	0	0	0.0%	0.0%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-002	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
Graphics										
										

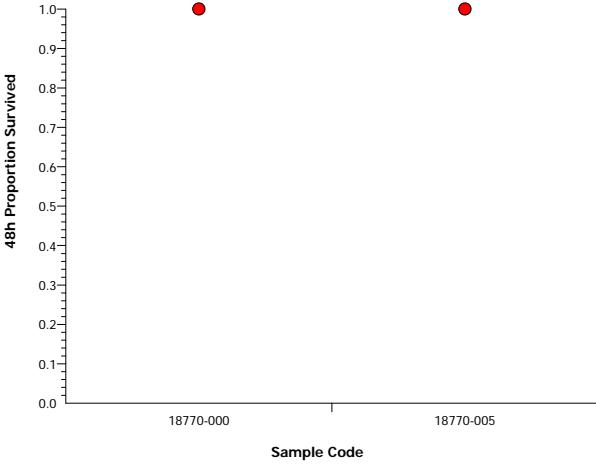
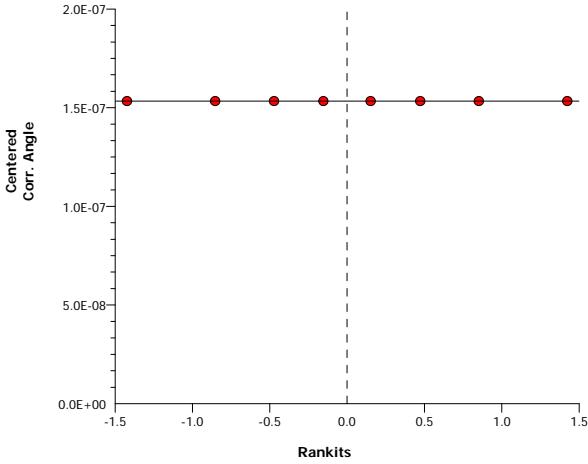
CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 8 of 9)
 Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test							EnviroSystems, Inc.			
Analysis No:	17-8143-7019	Endpoint:	48h Proportion Survived		CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	13-1803-3614	Test Type:	Survival (48h)				Analyst:			
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)				Diluent:	Not Applicable		
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia				Brine:	Generic commercial salts		
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH				Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					5.56%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-001	16		1	0.3429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0033199	0.0033199	1	1	0.3559	Non-Significant Effect				
Error	0.0199195	0.0033199	6							
Total	0.0232394	0.00666398	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-001	4	0.975	0.956	0.994	0.9	1	0.009285	0.05	5.13%	2.5%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-001	4	1.371	1.34	1.402	1.249	1.412	0.01513	0.08149	5.94%	2.89%
Graphics										
										

CETIS Analytical Report

Report Date: 27 Jul-09 10:51 (p 9 of 9)
Link/Link Code: 14-7067-7011/18770-Ab

Americamysis 48-Hr Survival Test						EnviroSystems, Inc.				
Analysis No:	00-2870-5123	Endpoint:	48h Proportion Survived			CETIS Version:	CETISv1.6.4			
Analyzed:	27 Jul-09 10:48	Analysis:	Nonparametric-Two Sample			Official Results:	Yes			
Test Run No:	13-1803-3614	Test Type:	Survival (48h)			Analyst:				
Start Date:	23 Jul-09 16:00	Protocol:	EPA/821/R-02-012 (2002)			Diluent:	Not Applicable			
Ending Date:	25 Jul-09 16:00	Species:	Americamysis bahia			Brine:	Generic commercial salts			
Duration:	48h	Source:	ARO - Aquatic Research Organisms, NH			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					2.5%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-005	18		1	0.4429	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0	0	1	65540	0.0000	Significant Effect				
Error	0	0	6							
Total	0	0	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances				
48h Proportion Survived Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1	1	1	1	1	0	0	0.0%	0.0%
18770-005	4	1	1	1	1	1	0	0	0.0%	0.0%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
18770-005	4	1.412	1.412	1.412	1.412	1.412	0	0	0.0%	0.0%
Graphics										
										



Aquatic Research Organisms

REC'D
8/23/09

DATA SHEET

I. Organism History

Species AMERICANASIS bahia

Source: Lab reared Hatchery reared _____ Field collected _____

Hatch date 7-16-09 Receipt date _____

Lot number 071609MS Strain _____

Brood origination Florida

II. Water Quality

Temperature 25 °C Salinity ~30 ppt D.O. - ppm

pH 7.8 su Hardness - ppm Alkalinity - ppm

III. Culture Conditions

Freshwater _____ Saltwater Other _____

Recirculating Flow through _____ Static _____

DIET: Flake food Phytoplankton _____ Trout chow

Artemia Rotifers _____ YCT _____ Other Except Shrimp Diet

Prophylactic treatments: _____

Comments: _____

IV. Shipping Information

Client: EST # of Organisms 240+

Carrier: _____ Date shipped 7-23-09

Biologist: Mark Desautel

***Arbacia punctulata* Chronic Fertilization Assay
Water Quality and Gamete Preparation Data**

STUDY: <u>18720</u> <u>018622</u>	CLIENT: Woods Hole Group	LOCATION: New Bedford	DATE: <u>7/23/09</u>	INITIALS: <u>JG</u>	
SALINITY ADJUSTMENT RECORD: <u>200</u> mL Ref + _____ g SALT					
SALINITY ADJUSTMENT RECORD: <u>200</u> mL 200 NTU + _____ g SALT					
SALINITY ADJUSTMENT RECORD: <u>200</u> mL 150 NTU + _____ g SALT					
SALINITY ADJUSTMENT RECORD: <u>200</u> mL 100 NTU + _____ g SALT					
SALINITY ADJUSTMENT RECORD: <u>200</u> mL 50 NTU + _____ g SALT					
SALINITY ADJUSTED SAMPLE	D.O. (mg/L)	pH (SU)	SPEC COND (μ mhos)	TEMP (°C)	SALINITY (ppt)
Lab Control	<u>7.2</u>	<u>8.11</u>	<u>46.336</u>	<u>23.20</u>	<u>30</u>
Reference Site <u>005</u>	<u>8.1</u>	<u>7.66</u>	<u>45550</u>	<u>20</u>	<u>29</u>
200 NTU <u>001</u>	<u>7.4</u>	<u>7.55</u>	<u>463740</u>	<u>20</u>	<u>30</u>
150 NTU <u>002</u>	<u>7.6</u>	<u>7.74</u>	<u>46340</u>	<u>20</u>	<u>30</u>
100 NTU <u>003</u>	<u>8.4</u>	<u>7.87</u>	<u>47950</u>	<u>20</u>	<u>31</u>
50 NTU <u>004</u>	<u>8.3</u>	<u>7.77</u>	<u>47660</u>	<u>20</u>	<u>31</u>

METERS USED

DO meter # 23 DO probe # 20 pH meter # 470 pH probe # 85 S/C meter # 15130D S/C probe # 15130D
SALINITY meter # 15130D

DATE & INITIALS FOR GAMETE PREPARATION: LB

SPERM DILUTIONS:

HEMACYTOMETER COUNT, E: 122 $\times 10^4$ = SPM SOLUTION E = 1.22 \times 10^6
SPERM CONCENTRATIONS:
SOLUTION E X 40 = SOLUTION A = 4.88 \times 10^7 SPM
SOLUTION E X 20 = SOLUTION B = 2.44 \times 10^7 SPM
SOLUTION E X 5 = SOLUTION C = 6.10 \times 10^6 SPM

FINAL COUNTS:

FINAL SPERM COUNT: 4.88 \times 10^7
FINAL EGG COUNT: 2400

TEST TIMES:

SPERM COLLECTED: 1345
EGGS COLLECTED: 1345
SPERM ADDED: 1425
EGGS ADDED: 1525
FIXATIVE ADDED: 1545

Arbacia punctulata Chronic Fertilization Assay

SAMPLE USE RECORD

STUDY:	CLIENT: Woods Hole Group New Bedford	
SPECIES: <i>A. punctulata</i>		
	Day: 0	
SAMPLE	Volume Used (mL)	ESI Cube ID
Lab Control	200 mL	—
Reference Site ⁰⁰⁵		005
200 NTU ⁰⁰¹		001
150 NTU ⁰⁰²		002
100 NTU ⁰⁰³		003
50 NTU ⁰⁰⁴		004
INITIALS:	SJ	
TIME:	1405	
DATE:	7/23/09	

FERTILIZATION COUNTS

STUDY <i>18720</i>	CLIENT Woods Hole Group	LOCATION New Bedford		DATE 7/23/09	
SAMPLE	REPLICATE VIAL				INITIALS UB
	1	2	3	4	
Lab Control	100/101	103/104	100/101	100/100	
Reference ⁰⁰⁵	101/101	101/101	109/111	101/103	
200 NTU ⁰⁰¹	101/108	100/108	100/108	100/104	
150 NTU ⁰⁰²	88/100	108/119	98/106	90/100	
100 NTU ⁰⁰³	100/106	103/104	102/102	100/101	
50 NTU ⁰⁰⁴	100/102	100/101	97/100	98/100	

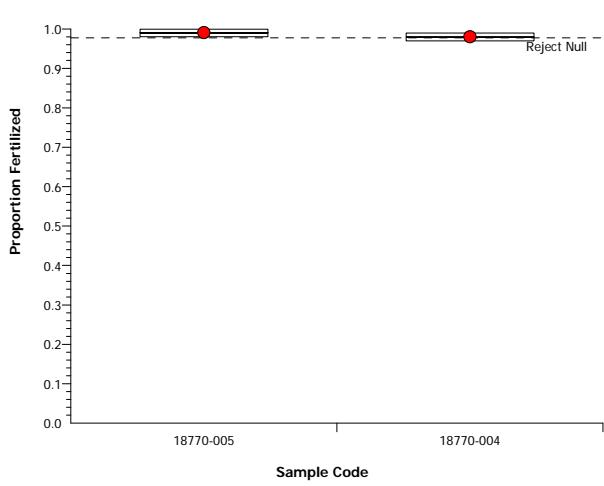
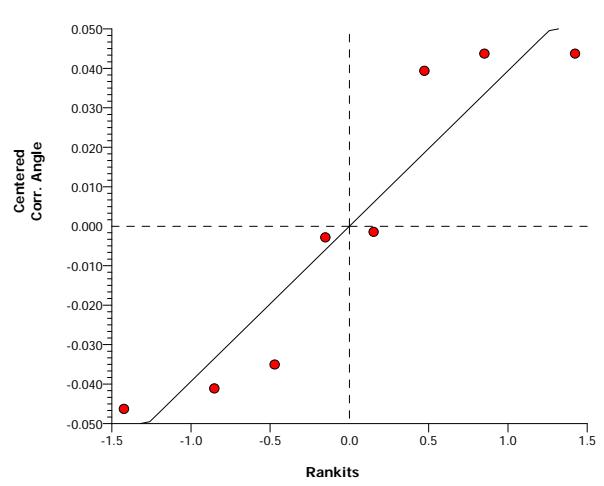
CETIS Summary Report

Report Date: 24 Jul-09 11:13 (p 1 of 1)
 Link/Link Code: 16-5654-6835/18770-Ap

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.						
Test Run No:		08-3312-6536	Test Type:		Fertilization	Analyst:							
Start Date:		23 Jul-09 14:25	Protocol:		EPA/821/R-02-014 (2002)	Diluent:		Not Applicable					
Ending Date:		23 Jul-09 15:45	Species:		Arbacia punctulata	Brine:		Generic commercial salts					
Duration:		80m	Source:		In-House Culture	Age:							
Sample Code	Sample No	Sample Date	Receive Date	Sample Age	Client Name	Project							
18770-000	06-7167-7012	23 Jul-09 12:00	23 Jul-09 12:00	2h	Woods Hole Group	Ecological Risk Assessme							
18770-005	03-9927-1818	22 Jul-09 09:49	22 Jul-09 17:47	29h									
18770-001	15-6024-8561	22 Jul-09 08:26	22 Jul-09 17:47	30h									
18770-002	05-1145-9131	22 Jul-09 09:52	22 Jul-09 17:47	29h									
18770-003	01-6638-4937	22 Jul-09 09:51	22 Jul-09 17:47	29h									
18770-004	06-1076-1745	22 Jul-09 09:51	22 Jul-09 17:47	29h									
Sample Code	Material Type	Sample Source		Station Location		Latitude	Longitude						
18770-000	Surface Water	New Bedford Harbor Dredge Moni Laboratory Water Control											
18770-005	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-005-072209 (Reference)											
18770-001	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-001-072209 (190 NTU)											
18770-002	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-002-072209 (140 NTU)											
18770-003	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-003-072209 (110 NTU)											
18770-004	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-004-072209 (092 NTU)											
Test Acceptability													
Analysis No	Endpoint	Attribute	Test Stat	Acceptability Limits	Overlap	Decision							
06-7656-2976	Proportion Fertilized	Control Resp	0.988	0.7 - 1	Yes	Passes acceptability criteria							
09-6737-1504	Proportion Fertilized	Control Resp	0.988	0.7 - 1	Yes	Passes acceptability criteria							
10-6690-2820	Proportion Fertilized	Control Resp	0.988	0.7 - 1	Yes	Passes acceptability criteria							
11-5470-6168	Proportion Fertilized	Control Resp	0.988	0.7 - 1	Yes	Passes acceptability criteria							
17-7985-6300	Proportion Fertilized	Control Resp	0.988	0.7 - 1	Yes	Passes acceptability criteria							
01-1516-8347	Proportion Fertilized	PMSD	0.01443	NL - 0.25	No	Passes acceptability criteria							
06-7656-2976	Proportion Fertilized	PMSD	0.01384	NL - 0.25	No	Passes acceptability criteria							
09-5020-8784	Proportion Fertilized	PMSD	0.01346	NL - 0.25	No	Passes acceptability criteria							
09-6737-1504	Proportion Fertilized	PMSD	0.01371	NL - 0.25	No	Passes acceptability criteria							
10-6690-2820	Proportion Fertilized	PMSD	0.01489	NL - 0.25	No	Passes acceptability criteria							
11-5470-6168	Proportion Fertilized	PMSD	0.02683	NL - 0.25	No	Passes acceptability criteria							
13-5798-4253	Proportion Fertilized	PMSD	0.01335	NL - 0.25	No	Passes acceptability criteria							
16-0058-2404	Proportion Fertilized	PMSD	0.02555	NL - 0.25	No	Passes acceptability criteria							
17-7985-6300	Proportion Fertilized	PMSD	0.0178	NL - 0.25	No	Passes acceptability criteria							
Proportion Fertilized Summary													
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%			
18770-000	4	0.988	0.9836	0.9924	0.9717	1	0.002157	0.01181	1.2%	0.0%			
18770-005	4	0.9906	0.9866	0.9947	0.9806	1	0.001976	0.01082	1.09%	-0.27%			
18770-001	4	0.9371	0.9309	0.9434	0.9259	0.9615	0.003074	0.01684	1.8%	5.14%			
18770-002	4	0.903	0.8961	0.9099	0.88	0.9245	0.00337	0.01846	2.04%	8.6%			
18770-003	4	0.981	0.9715	0.9905	0.9434	1	0.00465	0.02547	2.6%	0.71%			
18770-004	4	0.9801	0.9771	0.9832	0.97	0.9901	0.001498	0.008207	0.84%	0.79%			
Proportion Fertilized Detail													
Sample Code	Rep 1	Rep 2	Rep 3	Rep 4									
18770-000	0.9901	0.9717	0.9901	1									
18770-005	1	1	0.982	0.9806									
18770-001	0.9352	0.9259	0.9259	0.9615									
18770-002	0.88	0.9076	0.9245	0.9									
18770-003	0.9434	0.9904	1	0.9901									
18770-004	0.9804	0.9901	0.97	0.98									

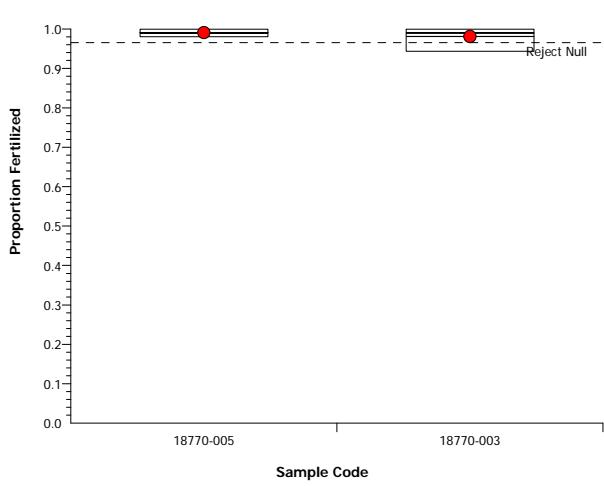
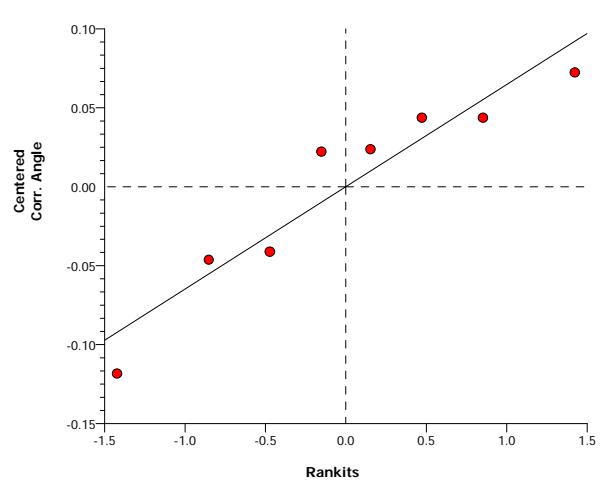
CETIS Analytical Report

Report Date: 24 Jul-09 10:19 (p 1 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	13-5798-4253	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:57	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					1.33%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-005		18770-004	1.543	1.943	0.05734	0.0869	Non-Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0041475	0.0041475	1	2.382	0.1737	Non-Significant Effect								
Error	0.0104487	0.0017415	6											
Total	0.0145962	0.005889	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		2.747	47.47	0.4286	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.8533		0.1030	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-005	4	0.9906	0.9865	0.9948	0.9806	1	0.00201	0.01082	1.09%					
18770-004	4	0.9801	0.977	0.9832	0.97	0.9901	0.001524	0.008207	0.84%					
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-005	4	1.477	1.458	1.497	1.431	1.521	0.009383	0.05053	3.42%					
18770-004	4	1.432	1.42	1.443	1.397	1.471	0.005661	0.03049	2.13%					
Graphics														
														
														

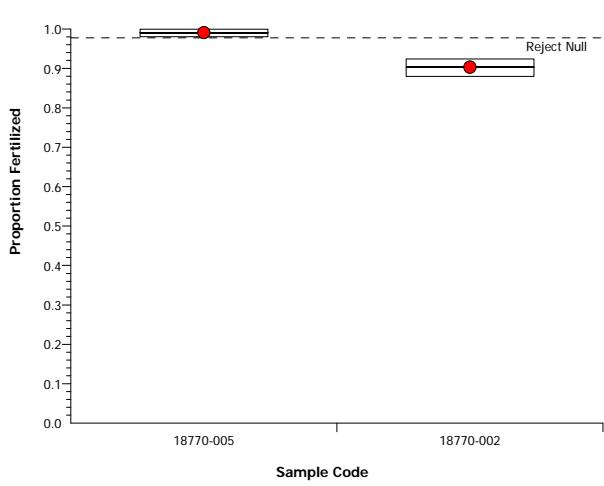
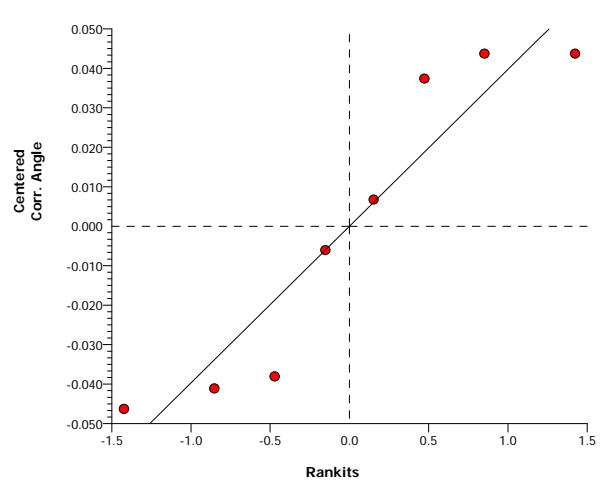
CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 2 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	16-0058-2404	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:57	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					2.56%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-005		18770-003	0.5887	1.943	0.09379	0.2888	Non-Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0016145	0.0016145	1	0.3465	0.5776	Non-Significant Effect								
Error	0.0279527	0.0046588	6											
Total	0.0295672	0.0062732	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		2.649	47.47	0.4448	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.9021		0.3020	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-005	4	0.9906	0.9865	0.9948	0.9806	1	0.00201	0.01082	1.09%					
18770-003	4	0.981	0.9713	0.9907	0.9434	1	0.004729	0.02547	2.6%					
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-005	4	1.477	1.458	1.497	1.431	1.521	0.009383	0.05053	3.42%					
18770-003	4	1.449	1.418	1.48	1.331	1.521	0.01527	0.08224	5.68%					
Graphics														
														
														

CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 3 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	09-5020-8784	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					1.35%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-005		18770-002	7.48	1.943	0.05772	0.0001	Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0987307	0.0987307	1	55.94	0.0003	Significant Effect								
Error	0.0105888	0.0017648	6											
Total	0.1093195	0.1004955	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		2.616	47.47	0.4506	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.8568		0.1116	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-005	4	0.9906	0.9865	0.9948	0.9806	1	0.00201	0.01082	1.09%	0.0%				
18770-002	4	0.903	0.896	0.91	0.88	0.9245	0.003428	0.01846	2.04%	8.84%				
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-005	4	1.477	1.458	1.497	1.431	1.521	0.009383	0.05053	3.42%	0.0%				
18770-002	4	1.255	1.243	1.267	1.217	1.292	0.005802	0.03124	2.49%	15.04%				
Graphics														
														
														

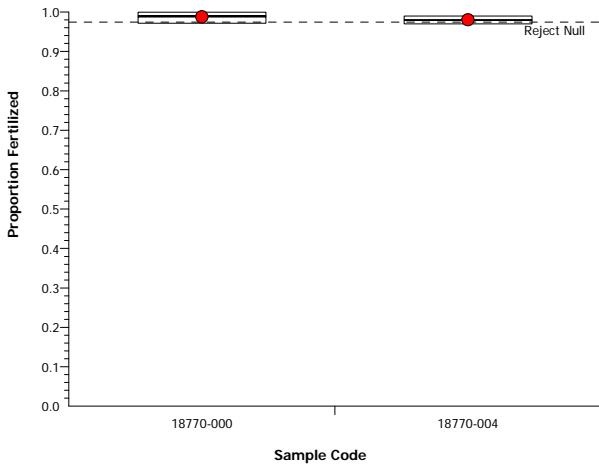
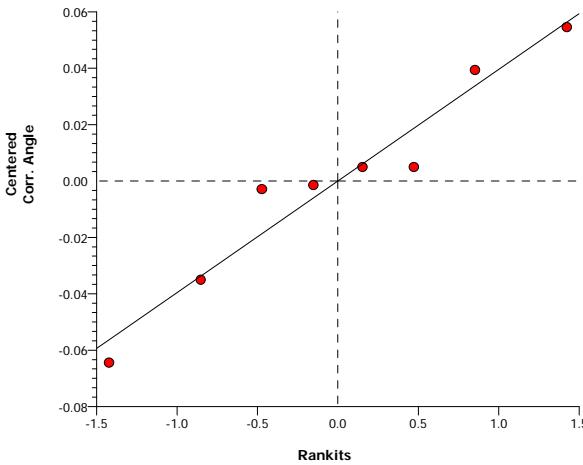
CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 4 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	01-1516-8347	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					1.44%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-005		18770-001	5.042	1.943	0.0609	0.0012	Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0499467	0.0499467	1	25.42	0.0024	Significant Effect								
Error	0.0117884	0.0019647	6											
Total	0.0617352	0.0519115	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		1.856	47.47	0.6243	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.8572		0.1125	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-005	4	0.9906	0.9865	0.9948	0.9806	1	0.00201	0.01082	1.09%	0.0%				
18770-001	4	0.9371	0.9307	0.9435	0.9259	0.9615	0.003127	0.01684	1.8%	5.4%				
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-005	4	1.477	1.458	1.497	1.431	1.521	0.009383	0.05053	3.42%	0.0%				
18770-001	4	1.319	1.305	1.333	1.295	1.373	0.006888	0.0371	2.81%	10.7%				
Graphics														

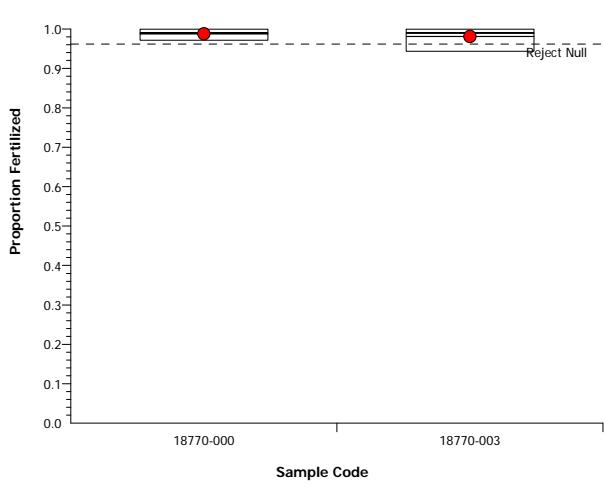
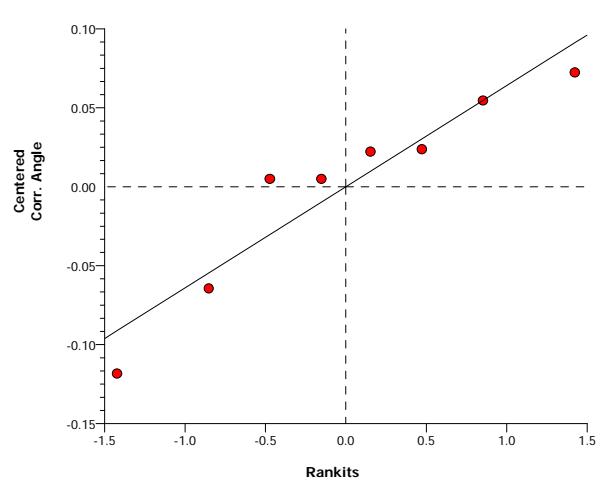
CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 5 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	09-6737-1504	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					1.37%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-000		18770-004	1.195	1.943	0.056	0.1386	Non-Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0023717	0.0023717	1	1.428	0.2772	Non-Significant Effect								
Error	0.0099678	0.0016613	6											
Total	0.0123395	0.0040330	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		2.575	47.47	0.4578	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.9493		0.7039	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-000	4	0.988	0.9835	0.9925	0.9717	1	0.002194	0.01181	1.2%					
18770-004	4	0.9801	0.977	0.9832	0.97	0.9901	0.001524	0.008207	0.84%					
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-000	4	1.466	1.448	1.485	1.402	1.521	0.009084	0.04892	3.34%					
18770-004	4	1.432	1.42	1.443	1.397	1.471	0.005661	0.03049	2.13%					
Graphics														
														
														

CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 6 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	11-5470-6168	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					2.68%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-000		18770-003	0.3618	1.943	0.09297	0.3650	Non-Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0005992	0.0005992	1	0.1309	0.7299	Non-Significant Effect								
Error	0.0274718	0.0045786	6											
Total	0.0280710	0.0051779	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		2.826	47.47	0.4162	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.9005		0.2922	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-000	4	0.988	0.9835	0.9925	0.9717	1	0.002194	0.01181	1.2%					
18770-003	4	0.981	0.9713	0.9907	0.9434	1	0.004729	0.02547	2.6%					
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%					
18770-000	4	1.466	1.448	1.485	1.402	1.521	0.009084	0.04892	3.34%					
18770-003	4	1.449	1.418	1.48	1.331	1.521	0.01527	0.08224	5.68%					
Graphics														
														
														

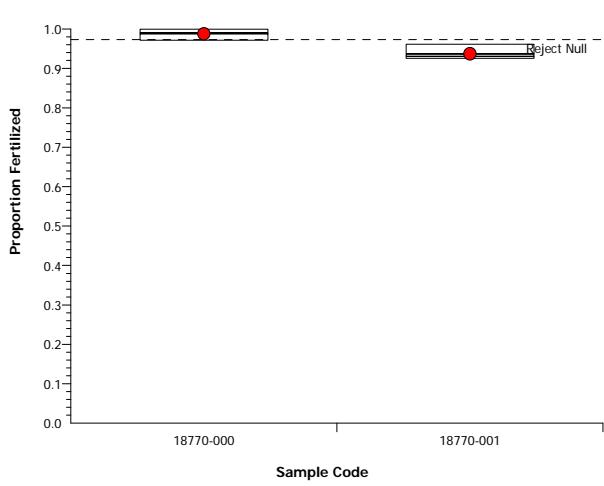
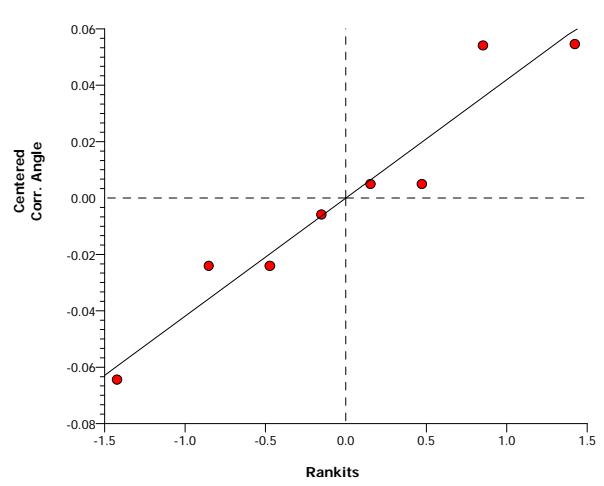
CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 7 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	06-7656-2976	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					1.38%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-000		18770-002	7.273	1.943	0.0564	0.0002	Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0891102	0.0891102	1	52.9	0.0003	Significant Effect								
Error	0.0101079	0.0016847	6											
Total	0.0992181	0.0907948	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		2.452	47.47	0.4808	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.9525		0.7360	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-000	4	0.988	0.9835	0.9925	0.9717	1	0.002194	0.01181	1.2%	0.0%				
18770-002	4	0.903	0.896	0.91	0.88	0.9245	0.003428	0.01846	2.04%	8.6%				
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-000	4	1.466	1.448	1.485	1.402	1.521	0.009084	0.04892	3.34%	0.0%				
18770-002	4	1.255	1.243	1.267	1.217	1.292	0.005802	0.03124	2.49%	14.4%				
Graphics														

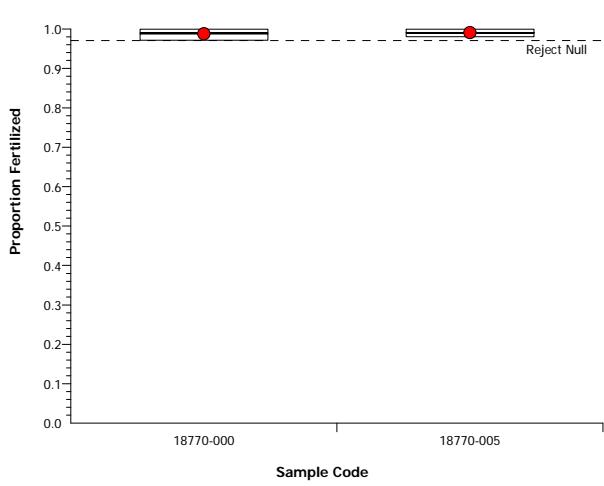
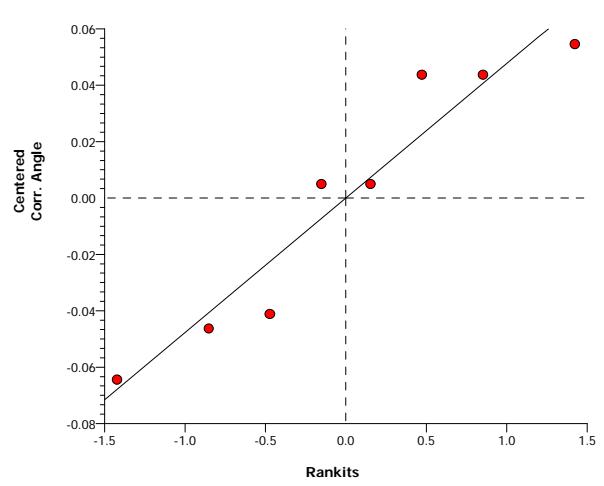
CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 8 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test							EnviroSystems, Inc.							
Analysis No:	10-6690-2820	Endpoint:	Proportion Fertilized				CETIS Version:	CETISv1.6.4						
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample				Official Results:	Yes						
Test Run No:	08-3312-6536	Test Type:	Fertilization				Analyst:							
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)				Diluent:	Not Applicable						
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata				Brine:	Generic commercial salts						
Duration:	80m	Source:	In-House Culture				Age:							
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD						
Angular (Corrected)		C > T	Not Run					1.49%						
Equal Variance t Two-Sample Test														
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)							
18770-000		18770-001	4.786	1.943	0.05965	0.0015	Significant Effect							
ANOVA Table														
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)								
Between	0.0431752	0.0431752	1	22.91	0.0030	Significant Effect								
Error	0.0113076	0.0018846	6											
Total	0.0544828	0.0450598	7											
ANOVA Assumptions														
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)								
Variances	Variance Ratio F		1.739	47.47	0.6606	Equal Variances								
Distribution	Shapiro-Wilk Normality		0.9284		0.5015	Normal Distribution								
Proportion Fertilized Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-000	4	0.988	0.9835	0.9925	0.9717	1	0.002194	0.01181	1.2%	0.0%				
18770-001	4	0.9371	0.9307	0.9435	0.9259	0.9615	0.003127	0.01684	1.8%	5.14%				
Angular (Corrected) Transformed Summary														
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%				
18770-000	4	1.466	1.448	1.485	1.402	1.521	0.009084	0.04892	3.34%	0.0%				
18770-001	4	1.319	1.305	1.333	1.295	1.373	0.006888	0.0371	2.81%	10.02%				
Graphics														
														
														

CETIS Analytical Report

Report Date: 24 Jul-09 10:20 (p 9 of 9)
 Link/Link Code: 16-5654-6835

Arbacia Sperm Cell Fertilization Test						EnviroSystems, Inc.				
Analysis No:	17-7985-6300	Endpoint:	Proportion Fertilized			CETIS Version:	CETISv1.6.4			
Analyzed:	23 Jul-09 16:56	Analysis:	Parametric-Two Sample			Official Results:	Yes			
Test Run No:	08-3312-6536	Test Type:	Fertilization			Analyst:				
Start Date:	23 Jul-09 14:25	Protocol:	EPA/821/R-02-014 (2002)			Diluent:	Not Applicable			
Ending Date:	23 Jul-09 15:45	Species:	Arbacia punctulata			Brine:	Generic commercial salts			
Duration:	80m	Source:	In-House Culture			Age:				
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Angular (Corrected)		C > T	Not Run					1.78%		
Equal Variance t Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)			
18770-000		18770-005	-0.3157	1.943	0.06833	0.6185	Non-Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.0002465	0.0002465	1	0.09968	0.7629	Non-Significant Effect				
Error	0.0148398	0.0024733	6							
Total	0.0150863	0.0027198	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Variance Ratio F		1.067	47.47	0.9587	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.8966		0.2691	Normal Distribution				
Proportion Fertilized Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	0.988	0.9835	0.9925	0.9717	1	0.002194	0.01181	1.2%	0.0%
18770-005	4	0.9906	0.9865	0.9948	0.9806	1	0.00201	0.01082	1.09%	-0.27%
Angular (Corrected) Transformed Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	1.466	1.448	1.485	1.402	1.521	0.009084	0.04892	3.34%	0.0%
18770-005	4	1.477	1.458	1.497	1.431	1.521	0.009383	0.05053	3.42%	-0.76%
Graphics										
										
										

STUDY NUMBER: 18770 CLIENT: Woods Hole NBH EFFLUENT: 001,002,003,004,005
DATE: 7/24/09 TECHNICIAN: UB

100% Effluent As Received Water Qualities:

04 Salinity 23.2 pH 7.27 S/C _____ TRC _____
002 19.0 7.37
003 17.4 7.40
005 21.5 1.54
004 21.4 1.54

Salinity Adjustment Record:

1000 mL Effluent + 7.88 g Sea Salts or- mL Spring Water
(Circle One)
13
14
10
3

Bottles Pulled:

Effluent: AMM TS/S TOC // Diluent: AMM TS/S TOC

DILUTIONS

STUDY: <u>18770</u>		CLIENT: <u>ENSR - New Bedford</u>			
SPECIES: <u>C. parvula</u>					
Diluent:	Day: 0 Start				
Lab Salt	Sample: <u>001, 002, 003, 004, 005</u>				
Concentration %	Vol. Eff.(mls)	Final Vol.(mls)			
0% Lab	800	800			
-6.25% 001					
12.5% 002					
25% 003					
50% 004					
100% 005					
INITIALS:	<u>UB</u>				
TIME:	<u>1405</u>				
DATE:	<u>7/24/09</u>				

***Champia parvula* Plant Viability Summary**

STUDY NUMBER:		18770	ASSAY START:		07/24/09	ASSAY END:		07/26/09
REP/Branch	CONTROL	001	002	003	004	005		
A	4	0	1	2	3	3		
	2	1	0	1	2	3	3	
	3	0	1	2	3	4		
	4	0	0	2	2	3		
	5	1	0	1	2	3	3	
B	4	0	1	2	3	4		
	2	1	0	1	2	3	3	
	3	0	0	2	3	4		
	4	0	1	2	3	3		
	5	1	0	1	2	3	3	
C	4	0	1	1	3	3		
	2	0	1	2	2	3		
	3	0	1	2	3	3		
	4	0	1	2	3	3		
	5	0	1	2	3	3		
D	4	0	0	2	3	3		
	2	0	1	2	3	3		
	3	0	1	2	3	4		
	4	0	1	2	3	3		
	5	0	0	2	3	3		
SALINITY	28	30	29	31	30	30		
pH (SU)	7.08	7.50	7.65	7.73	7.70	7.65		
S/C (μ mhos)	45500	46000	45870	48670	46580	46320		
TEMP (°C)	24							
TRC	<0.02							—

pH meter# 1097 pH probe# 73 S/C meter# 3 S/C probe# 82 Salinity meter# YSI 361

Scoring for Acute Assay Endpoint - Plant Health/Viability

SCORE	Description
4	Plants with good color and no signs of degeneration
3	Color faded - some sign of bleaching color light red to pink; no branch tip degeneration
2	Color faded - light pink; no green, yellow or white branch tips; no branch tip degeneration
1	Color yellow to white; no branch tip degeneration
0	Color limited to white; signs of branch tip degeneration

Technician Initials : DAB/LB

CETIS Summary Report

Report Date: 27 Jul-09 11:02 (p 1 of 1)

Link/Link Code:

15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint						EnviroSystems, Inc.				
Test Run No:	15-5181-9457	Test Type:	Champia			Analyst:				
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)			Diluent:	Not Applicable			
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula			Brine:	Not Applicable			
Duration:	50h	Source:	Saskatchewan Research Council			Age:				
Sample Code	Sample No	Sample Date	Receive Date	Sample Age	Client Name	Project				
18770-000	06-7167-7012	23 Jul-09 12:00	23 Jul-09 12:00	27h	Woods Hole Group	Ecological Risk Assessme				
18770-005	03-9927-1818	22 Jul-09 09:49	22 Jul-09 17:47	54h						
18770-001	15-6024-8561	22 Jul-09 08:26	22 Jul-09 17:47	55h						
18770-002	05-1145-9131	22 Jul-09 09:52	22 Jul-09 17:47	54h						
18770-003	01-6638-4937	22 Jul-09 09:51	22 Jul-09 17:47	54h						
18770-004	06-1076-1745	22 Jul-09 09:51	22 Jul-09 17:47	54h						
Sample Code	Material Type	Sample Source		Station Location		Latitude	Longitude			
18770-000	Surface Water	New Bedford Harbor Dredge Moni Laboratory Water Control								
18770-005	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-005-072209 (Reference)								
18770-001	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-001-072209 (190 NTU)								
18770-002	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-002-072209 (140 NTU)								
18770-003	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-003-072209 (110 NTU)								
18770-004	Surface Water	New Bedford Harbor Dredge Moni DS-TOX-004-072209 (092 NTU)								
<u>Mean Cystocarps Summary</u> Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	4	4	4	4	4	0	0	0.0%	0.0%
18770-005	4	3.2	3.139	3.261	3	3.4	0.02981	0.1633	5.1%	20.0%
18770-001	4	0	0	0	0	0	0	0		100.0%
18770-002	4	0.8	0.739	0.861	0.6	1	0.02981	0.1633	20.41%	80.0%
18770-003	4	1.95	1.913	1.987	1.8	2	0.01826	0.1	5.13%	51.25%
18770-004	4	2.9	2.857	2.943	2.8	3	0.02108	0.1155	3.98%	27.5%
<u>Mean Cystocarps Detail</u> Branch Viability Detail										
Sample Code	Rep 1	Rep 2	Rep 3	Rep 4						
18770-000	4	4	4	4						
18770-005	3.2	3.4	3	3.2						
18770-001	0	0	0	0						
18770-002	0.8	0.8	1	0.6						
18770-003	2	2	1.8	2						
18770-004	2.8	3	2.8	3						

CETIS Analytical Report

Report Date: 27 Jul-09 11:05 (p 1 of 9)
 Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint							EnviroSystems, Inc.			
Analysis No:	07-2840-3294	Endpoint:	Mean Cystocarps Plant Viability		CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 11:00	Analysis:	Parametric-Two Sample				Official Results: Yes			
Test Run No:	15-5181-9457	Test Type:	Champia				Analyst:			
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)				Diluent:	Not Applicable		
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula				Brine:	Not Applicable		
Duration:	50h	Source:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					6.07%		
Equal Variance t Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)			
18770-005		18770-004	3	1.943	0.1943	0.0120	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	0.18	0.18	1	9	0.0240	Significant Effect				
Error	0.12	0.02	6							
Total	0.3	0.2	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Variance Ratio F		2	47.47	0.5836	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.9651		0.8568	Normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	3.2	3.138	3.262	3	3.4	0.03032	0.1633	5.1%	0.0%
18770-004	4	2.9	2.856	2.944	2.8	3	0.02144	0.1155	3.98%	9.38%
Graphics										

CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 2 of 9)
 Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint							EnviroSystems, Inc.			
Analysis No:	08-4729-3241	Endpoint:	Mean Cystocarps Plant Viability		CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 11:00	Analysis:	Parametric-Two Sample				Official Results:	Yes		
Test Run No:	15-5181-9457	Test Type:	Champia				Analyst:			
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)				Diluent:	Not Applicable		
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula				Brine:	Not Applicable		
Duration:	50h	Source:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					5.81%		
Equal Variance t Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)			
18770-005		18770-003	13.06	1.943	0.186	0.0000	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	3.125	3.125	1	170.5	0.0000	Significant Effect				
Error	0.11	0.0183333	6							
Total	3.235	3.143333	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Variance Ratio F		2.667	47.47	0.4419	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.9128		0.3739	Normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	3.2	3.138	3.262	3	3.4	0.03032	0.1633	5.1%	0.0%
18770-003	4	1.95	1.912	1.988	1.8	2	0.01857	0.1	5.13%	39.06%
Graphics										

CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 3 of 9)
 Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint						EnviroSystems, Inc.				
Analysis No:	17-5710-5878	Endpoint:	Mean Cystocarps	Plant Viability	CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 11:00	Analysis:	Parametric-Two Sample			Official Results:	Yes			
Test Run No:	15-5181-9457	Test Type:	Champia			Analyst:				
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)			Diluent:	Not Applicable			
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula			Brine:	Not Applicable			
Duration:	50h	Source:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					7.01%		
Equal Variance t Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)			
18770-005		18770-002	20.78	1.943	0.2244	0.0000	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	11.52	11.52	1	432	0.0000	Significant Effect				
Error	0.16	0.0266667	6							
Total	11.68	11.54667	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Variance Ratio F		1	47.47	1.0000	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.8489		0.0929	Normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	3.2	3.138	3.262	3	3.4	0.03032	0.1633	5.1%	0.0%
18770-002	4	0.8	0.7379	0.8621	0.6	1	0.03032	0.1633	20.41%	75.0%
Graphics										

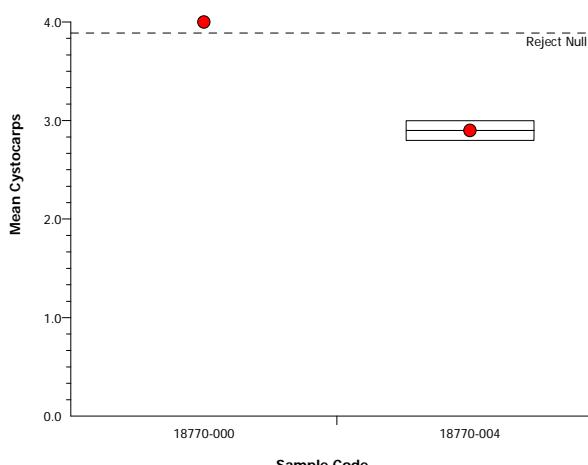
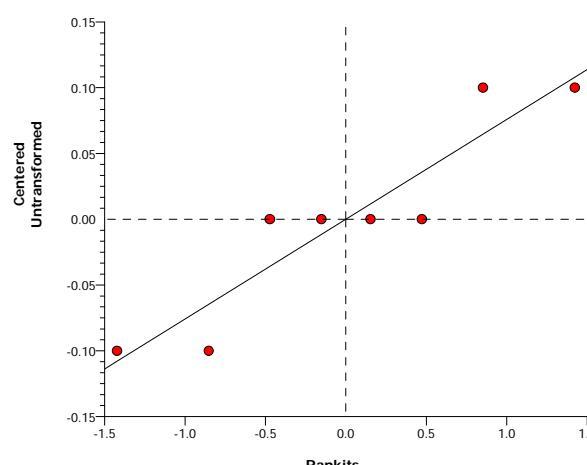
CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 4 of 9)
 Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint							EnviroSystems, Inc.			
Analysis No:	02-0675-1624	Endpoint:	Mean Cystocarps	Plant Viability	CETIS Version:		CETISv1.6.4			
Analyzed:	27 Jul-09 11:00	Analysis:	Nonparametric-Two Sample				Official Results:			
Test Run No:	15-5181-9457	Test Type:	Champia				Analyst:			
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)				Diluent:	Not Applicable		
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula				Brine:	Not Applicable		
Duration:	50h	Source:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					4.96%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-005		18770-001	10		0	0.0143	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	20.48	20.48	1	1536	0.0000	Significant Effect				
Error	0.08	0.0133333	6							
Total	20.56	20.49333	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		3	13.75	0.1340	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7322		0.0052	Non-normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-005	4	3.2	3.138	3.262	3	3.4	0.03032	0.1633	5.1%	0.0%
18770-001	4	0	0	0	0	0	0	0		100.0%
Graphics										

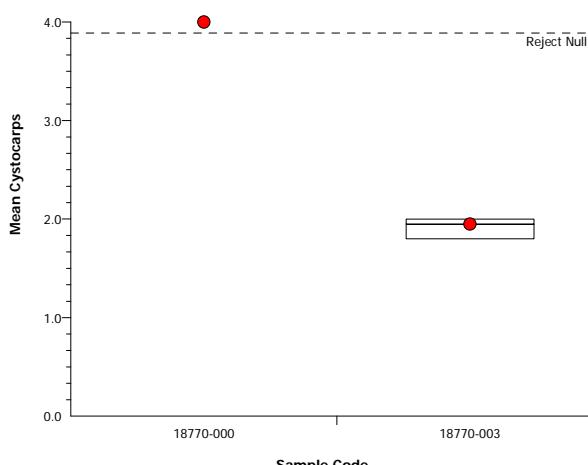
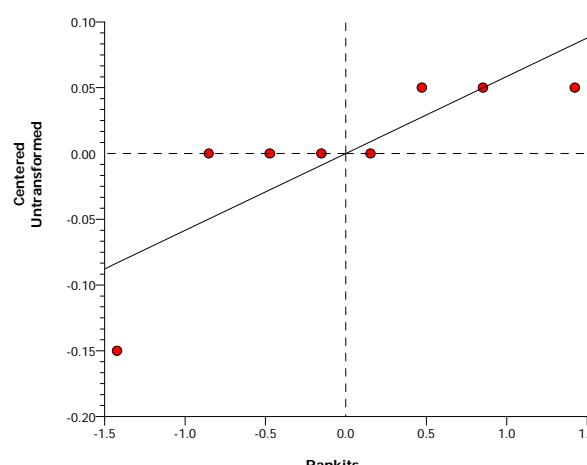
CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 5 of 9)
Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint							EnviroSystems, Inc.			
Analysis No:	16-1616-7438	Endpoint:	Mean Cystocarps Plant Viability				CETIS Version:	CETISv1.6.4		
Analyzed:	27 Jul-09 11:00	Analysis:	Parametric-Two Sample				Official Results:	Yes		
Test Run No:	15-5181-9457	Test Type:	Champia				Analyst:			
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)				Diluent:	Not Applicable		
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula				Brine:	Not Applicable		
Duration:	50h	Source:					Age:			
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					2.8%		
Equal Variance t Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	MSD	P-Value	Decision(5%)			
18770-000		18770-004	19.05	1.943	0.1122	0.0000	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	2.42	2.42	1	363	0.0000	Significant Effect				
Error	0.04	0.0066667	6							
Total	2.46	2.426667	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		65540	13.75	0.0000	Unequal Variances				
Distribution	Shapiro-Wilk Normality		0.8489		0.0929	Normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	4	4	4	4	4	0	0	0.0%	0.0%
18770-004	4	2.9	2.856	2.944	2.8	3	0.02144	0.1155	3.98%	27.5%
Graphics										
										

CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 6 of 9)
Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint							EnviroSystems, Inc.			
Analysis No:	20-3632-1340	Endpoint:	Mean Cystocarps Plant Viability		CETIS Version:	CETISv1.6.4				
Analyzed:	27 Jul-09 11:00	Analysis:	Nonparametric-Two Sample				Official Results:	Yes		
Test Run No:	15-5181-9457	Test Type:	Champia				Analyst:			
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)				Diluent:	Not Applicable		
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula				Brine:	Not Applicable		
Duration:	50h	Source:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					2.43%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-003	10		0	0.0143	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	8.405	8.405	1	1681	0.0000	Significant Effect				
Error	0.03	0.005	6							
Total	8.434999	8.41	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Varianc		1	13.75	0.3559	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7065		0.0027	Non-normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	4	4	4	4	4	0	0	0.0%	0.0%
18770-003	4	1.95	1.912	1.988	1.8	2	0.01857	0.1	5.13%	51.25%
Graphics										
										
										

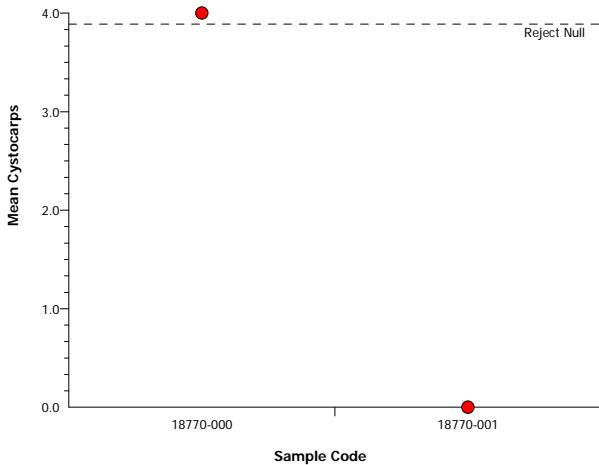
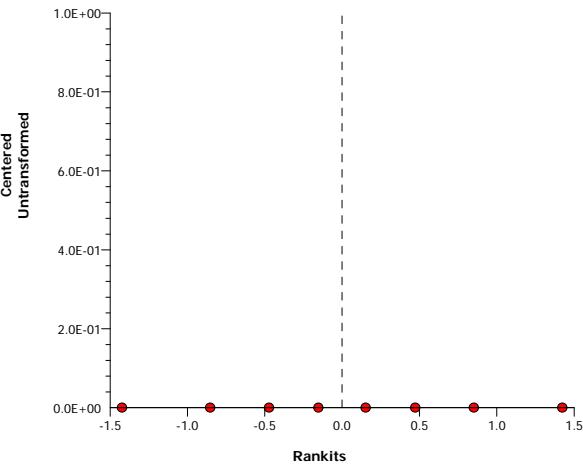
CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 7 of 9)
 Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint							EnviroSystems, Inc.			
Analysis No:	21-0469-8663	Endpoint:	Mean Cystocarps	Plant Viability	CETIS Version:		CETISv1.6.4			
Analyzed:	27 Jul-09 11:00	Analysis:	Nonparametric-Two Sample				Official Results:			
Test Run No:	15-5181-9457	Test Type:	Champia				Analyst:			
Start Date:	24 Jul-09 15:25	Protocol:	EPA/600/4-91/003 (1994)				Diluent:	Not Applicable		
Ending Date:	26 Jul-09 17:45	Species:	Champia parvula				Brine:	Not Applicable		
Duration:	50h	Source:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					3.97%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-002	10		0	0.0143	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	20.48	20.48	1	1536	0.0000	Significant Effect				
Error	0.08	0.0133333	6							
Total	20.56	20.49333	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Variance		3	13.75	0.1340	Equal Variances				
Distribution	Shapiro-Wilk Normality		0.7322		0.0052	Non-normal Distribution				
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	4	4	4	4	4	0	0	0.0%	0.0%
18770-002	4	0.8	0.7379	0.8621	0.6	1	0.03032	0.1633	20.41%	80.0%
Graphics										

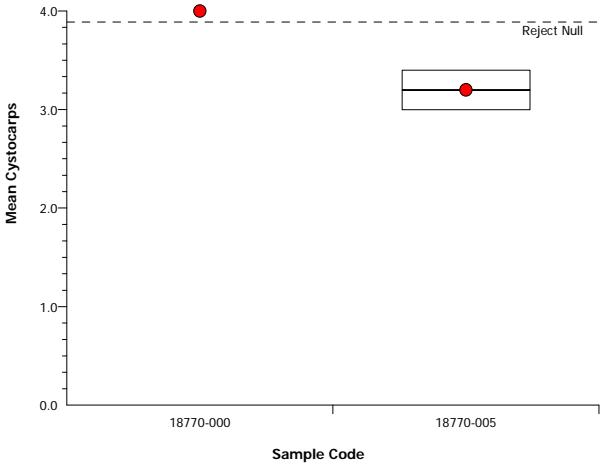
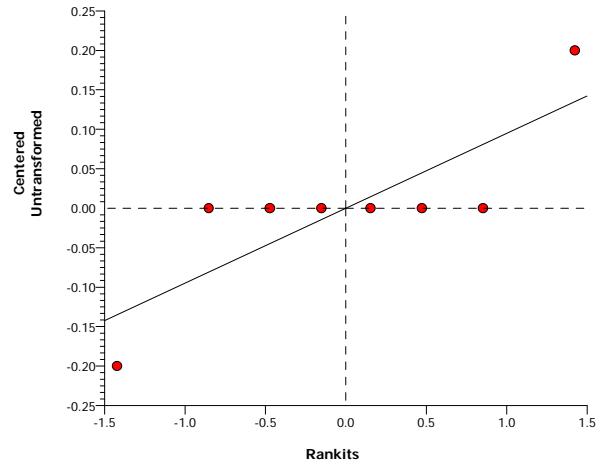
CETIS Analytical Report

Report Date: 27 Jul-09 11:06 (p 8 of 9)
Link/Link Code: 15-1550-6597

Champia parvula Red Macroalgae Sexual Reproduction Test Branch Tip Viability Endpoint		EnviroSystems, Inc.								
Analysis No: 10-2051-9019 Analyzed: 27 Jul-09 11:00	Endpoint: Mean Cystocarps Plant Viability Analysis: Nonparametric-Two Sample	CETIS Version: CETISv1.6.4 Official Results: Yes								
Test Run No: 15-5181-9457 Start Date: 24 Jul-09 15:25 Ending Date: 26 Jul-09 17:45 Duration: 50h	Test Type: Champia Protocol: EPA/600/4-91/003 (1994) Species: Champia parvula Source:	Analyst: Diluent: Not Applicable Brine: Not Applicable Age:								
Data Transform	Zeta	Alt Hyp Monte Carlo								
Untransformed	C > T	Not Run								
Wilcoxon Rank Sum Two-Sample Test										
Sample Code vs Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)					
18770-000 vs 18770-001	10	0	0.0143	Significant Effect						
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	32	32	1	65540	0.0000	Significant Effect				
Error	0	0	6							
Total	32	32	7							
ANOVA Assumptions										
Attribute	Test	Test Stat	Critical	P-Value	Decision(1%)					
Variances	Mod Levene Equality of Variance	65540	13.75	0.0000	Unequal Variances					
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	4	4	4	4	4	0	0	0.0%	0.0%
18770-001	4	0	0	0	0	0	0	0		100.0%
Graphics										
										
										

CETIS Analytical Report

Report Date: 27 Jul-09 11:07 (p 9 of 9)
 Link/Link Code: 15-1550-6597

Champia parvula Red Macroalga Sexual Reproduction Test Branch Tip Viability Endpoint				EnviroSystems, Inc.						
Analysis No: 21-2050-8151 Analyzed: 27 Jul-09 11:00	Endpoint: Mean Cystocarps Plant Viability Analysis: Nonparametric-Two Sample	CETIS Version: CETISv1.6.4 Official Results: Yes								
Test Run No: 15-5181-9457 Start Date: 24 Jul-09 15:25 Ending Date: 26 Jul-09 17:45 Duration: 50h	Test Type: Champia Protocol: EPA/600/4-91/003 (1994) Species: Champia parvula Source:	Analyst: Diluent: Not Applicable Brine: Not Applicable Age:								
Data Transform	Zeta	Alt Hyp	Monte Carlo	NOEL	LOEL	TOEL	TU	PMSD		
Untransformed		C > T	Not Run					3.97%		
Wilcoxon Rank Sum Two-Sample Test										
Sample Code	vs	Sample Code	Test Stat	Critical	Ties	P-Value	Decision(5%)			
18770-000		18770-005	10		0	0.0143	Significant Effect			
ANOVA Table										
Source	Sum Squares	Mean Square	DF	F Stat	P-Value	Decision(5%)				
Between	1.28	1.28	1	96	0.0001	Significant Effect				
Error	0.08	0.0133333	6							
Total	1.36	1.293333	7							
ANOVA Assumptions										
Attribute	Test		Test Stat	Critical	P-Value	Decision(1%)				
Variances	Mod Levene Equality of Variance	3	13.75	0.1340	Equal Variances					
Distribution	Shapiro-Wilk Normality	0.7322		0.0052	Non-normal Distribution					
Mean Cystocarps Summary Branch Viability Summary										
Sample Code	Count	Mean	95% LCL	95% UCL	Min	Max	Std Err	Std Dev	CV%	Diff%
18770-000	4	4	4	4	4	4	0	0	0.0%	0.0%
18770-005	4	3.2	3.138	3.262	3	3.4	0.03032	0.1633	5.1%	20.0%
Graphics										
										
										

SALTWATER ASSAYS

A. bahia, A. punctulata, C. parvula

STUDY: 181022	LOCATION: New Bedford Harbor					
CHEMISTRY						
	Lab Salt Control	-001 Reference Site 200 NTU	-002 200 NTU 150 NTU	-003 150 NTU 100 NTU	-004 100 NTU 50 NTU	-005 50 NTU Ref
AMMONIA	18108-01	181022-006	007	008	009	010
AS RECEIVED WATER QUALITIES	181022-006					
SALINITY (ppt)	25.0	23.2	19	17.4	21.5	27.4
pH (SU)	7.97	7.27	7.37	7.40	7.54	7.71
TRC (mg/L)	20.02	20.02	20.02	20.02	20.02	20.02
DO (mg/L)	7.2	7.0	6.9	6.9	6.8	6.2
S/C (μ mhos/cm)	38360					
WQ STATION USED	1					
INITIALS	LRO					
A. bahia SALINITY ADJUSTMENT RECORD						
SAMPLE (mLs)		4000	4000	4000	4000	4000
SEA SALT (g)		9	28	35	16	—
DATE:	7/23/09					
TIME:	1400					
INITIALS:	SJ					

Sample ID	ESI Cube ID
-001	-001
-002	-002
-003	-003
-004	-004
-005	-005

DILUTIONS

STUDY: <u>18720</u>	CLIENT: Woods Hole Group	
SPECIES: <i>A. bahia</i>		
	Sample: New Bedford Harbor	
Concentration %	Vol. Eff.(mls)	Final Vol.(mls)
Lab	0	800
Reference Water ⁰⁰⁵	800	
50 NTU ⁰⁰⁴		
100 NTU ⁰⁰³		
150 NTU ⁰⁰²		
200 NTU ⁰⁰¹	↓	↓
INITIALS:	<u>SJ</u>	
TIME:	<u>1500</u>	
DATE:	<u>7/24/09</u>	

RECORD OF METERS USED

STUDY: 18720	CLIENT: Woods Hole Group					
<i>A.bahia</i>						
Exposure (Hours)						
	0	24	48			
Water Quality Station #	2	2				
Initials / Date	SJ 7/28/09	SJ 7/24				

Water Quality Station #1	Water Quality Station #2	COMMENTS
DO meter #	DO meter #	23
DO probe #	DO probe #	20
pH meter #	pH meter #	470
pH probe #	pH probe #	85
S/C meter #	S/C meter #	Y61301)
S/C probe #	S/C probe #	↓
Salinity meter #	Salinity meter #	

Report No: 18770
Project: NBH Monitoring

SDG:

Sample ID: DS-TOX-001-072209
Matrix: Water
Sampled: 07/22/09 0826

Parameter	Result	Quant Limit	Units	Date Prepared	Date of Analysis	INIT/Method/Reference
Ammonia-N	18770-006	0.15	mg/L as N	07/27/09	07/27/09	MES/SM 4500-NH3 G

Sample ID: DS-TOX-002-072209
Matrix: Water
Sampled: 07/22/09 0952

Parameter	Result	Quant Limit	Units	Date Prepared	Date of Analysis	INIT/Method/Reference	
Ammonia-N	18770-007	ND	0.1	mg/L as N	07/27/09	07/27/09	MES/SM 4500-NH3 G

Sample ID: DS-TOX-003-072209
Matrix: Water
Sampled: 07/22/09 0951

Parameter	Result	Quant Limit	Units	Date Prepared	Date of Analysis	INIT/Method/Reference	
Ammonia-N	18770-008	ND	0.1	mg/L as N	07/27/09	07/27/09	MES/SM 4500-NH3 G

Sample ID: DS-TOX-004-072209
Matrix: Water
Sampled: 07/22/09 0951

Parameter	Result	Quant Limit	Units	Date Prepared	Date of Analysis	INIT/Method/Reference	
Ammonia-N	18770-009	ND	0.1	mg/L as N	07/27/09	07/27/09	MES/SM 4500-NH3 G

Sample ID: DS-TOX-005-072209
Matrix: Water
Sampled: 07/23/09 0949

Parameter	Result	Quant Limit	Units	Date Prepared	Date of Analysis	INIT/Method/Reference	
Ammonia-N	18770-010	ND	0.1	mg/L as N	07/27/09	07/27/09	MES/SM 4500-NH3 G

Notes:

ND = Not Detected

ESI

Report No: 18708
Project: Laboratory Seawater

Sample ID: Lab Salt 07/23/09
Matrix: Water
Sampled: 07/23/09

Parameter	Result	Quant Limit	Units	Date Prepared	Date of Analysis	INIT/Method/Reference
Ammonia-N	18708-027	ND	0.1	mg/L as N	07/27/09	07/27/09 MES/SM 4500-NH3 G

Notes:

ND = Not Detected

ESI

SAMPLE RECEIPT AND CONDITION DOCUMENTATION

Page 1 of 1

STUDY NO: *18770*
 SDG No:
 Project: New Bedford Harbor Monitoring
 Delivered via: Client
 Date and Time Received: 07/23/09 1747 Date and Time Logged into Lab: 01/23/09 0820
 Received By: SJ Logged into Lab by: SJ *H*
 Air bill / Way bill: No Air bill included in folder if received? NA
 Cooler on ice/packs: Yes Custody Seals present? NA
 Cooler Blank Temp (C) at arrival: 2 Custody Seals intact? NA
 Number of COC Pages: 1
 COC Serial Number(s):
 COC Complete:
 Sampled Date: Yes Does the info on the COC match the samples? Yes
 Field ID complete: Yes Were samples received within holding time? Yes
 Sampled Time: Yes Were all samples properly labeled? Yes
 Analysis request: Yes Were proper sample containers used? Yes
 COC Signed and dated: Yes Were samples received intact? (none broken or leaking) Yes
 Were all samples received? Yes Were sample volumes sufficient for requested analysis? Yes
 Client notification/authorization: Not required Were VOC vials free of headspace? NA

Field ID	Lab ID	Mx	Analysis Requested	Bottle	Req'd	Verified
				Pres'n	Pres'n	
DS-TOX-001-072209	<i>18622-001</i>	W	AB48AD, AP01CR, CP48AD;	20 L	4C	
DS-TOX-002-072209	<i>18622-002</i>	W	AB48AD, AP01CR, CP48AD;	20 L	4C	
DS-TOX-003-072209	<i>18622-003</i>	W	AB48AD, AP01CR, CP48AD;	20 L	4C	
DS-TOX-004-072209	<i>18622-004</i>	W	AB48AD, AP01CR, CP48AD;	20 L	4C	
DS-TOX-005-072209	<i>18622-005</i>	W	AB48AD, AP01CR, CP48AD;	20 L	4C	

Notes and qualifications:

CHAIN OF CUSTODY DOCUMENTATION

~~3) 1862~~ 18770
TAF 7/23/09

Client: Woods Hole Group	Contact: Dave Walsh	Project Name: NBH monitoring	Page 1 of 1												
Report to: Dave Walsh	Address: 81 Technology Park	Project Number: TO-0010													
Invoice to: Cathy Morey	Address: E. Falmouth, MA	Project Manager: Dave Walsh													
Voice: 508-540-8080	Fax: 508-540-1001	email: dwalsh@whgrp.com	P.O. No: Quote No:												
Protocol:	RCRA	SDWA	NPDES	USCOE	Other	Date Sampled	Time Sampled	Sampled By	Grab or com-posit (G/C)	Container Size (ml.) (500mL)	Container Type (P/G/T)	Field Preservation	Matrix S=Solid W=Water	Filter N=Not needed F=Done in field L=Lab to do	Analyses Requested\\Special Instructions:
Lab Number (assigned by lab)	Your Field ID: (must agree with container)														
001	DS - TOX - 001 - 072209	7/22	0826	KGM	G	20L	P	N/A	W	N	toxicity XXXXXX (acute)				
002	DS - TOX - 002 - 072209	7/22	0952	KGM	C	20L	P	N/A	W	N	acute toxicity				
003	DS - TOX - 003 - 072209	7/22	0951	KGM	C	20L	P	N/A	W	N	acute toxicity				
004	DS - TOX - 004 - 072209	7/22	0951	KGM	C	20L	P	N/A	W	N	acute toxicity				
005	DS - TOX - 005 - 072209	7/22	0949	KGM	G	20L	P	N/A	W	N	acute toxicity				
Relinquished By: Kaitlyn McCartney	Date: 7/22/09	Time: 1355	Received By: MARTIN POTTER	Date: 07/22/09	Time: 1355										
Relinquished By: MARTIN POTTER	Date: 07/22/09	Time: 1747	Received at Lab By: MULLEN	Date: 7/22/09	Time: 1747										
Comments:															

COC Doc No: 3765

Sample Delivery Group No

Page 0

٧٣